Technical Information
Proline Promass G 100

Coriolis flowmeter



The most compact high-pressure sensor with an ultra-compact transmitter

Application

- Measuring principle operates independently of physical fluid properties such as viscosity or density
- Accurate measurement of liquids and gases in high-pressure applications

Device properties

- Internal threads as process connection
- Process pressure up to 350 bar (5080 psi)
- Rupture disc available
- Robust, ultra-compact transmitter housing
- Pre-configured plug connector
- Local display available

Your benefits

- Easy and safe process integration – threaded connections
- Fewer process measuring points – multivariable measurement (flow, density, temperature)
- Space-saving installation – no in/outlet run needs
- Space-saving transmitter – full functionality on the smallest footprint
- Time-saving local operation without additional software and hardware – integrated web server
- Integrated verification – Heartbeat Technology™

Endress+Hauser
People for Process Automation

Table of contents

Document information 3
Symbols used 3

Function and system design 4
Measuring principle 4
Measuring system 4
Device architecture 5
Safety 5

Input 6
Measured variable 6
Measuring range 6
Operable flow range 6

Output 7
Output signal 7
Signal on alarm 8
Ex connection data 10
Low flow cut off 10
Galvanic isolation 11
Protocol-specific data 11

Power supply 16
Terminal assignment 16
Pin assignment, device plug 21
Supply voltage 24
Power consumption 24
Current consumption 24
Power supply failure 24
Electrical connection 25
Potential equalization 28
Terminals 28
Cable entries 29
Cable specification 29

Performance characteristics 30
Reference operating conditions 30
Maximum measured error 30
Repeatability 31
Response time 32
Influence of ambient temperature 32
Influence of medium temperature 32
Influence of medium pressure 32
Design fundamentals 32

Installation 33
Mounting location 33
Orientation 34
Inlet and outlet runs 34
Special mounting instructions 35
Mounting Safety Barrier Promass 100 35

Environment 35
Ambient temperature range 35
Storage temperature 37
Climate class 37
Degree of protection 37
Shock resistance 38
Vibration resistance 38
Electromagnetic compatibility (EMC) 38

Process 38
Medium temperature range 38
Density 38
Pressure-temperature ratings 38
Rupture disk 38
Flow limit 38
Pressure loss 39
System pressure 39
Thermal insulation 39
Vibrations 39

Mechanical construction 40
Design, dimensions 40
Weight 43
Materials 43
Process connections 45

Operability 45
Operating concept 45
Local display 45
Remote operation 46
Service interface 47

Certificates and approvals 49
CE mark 49
C-Tick symbol 49
Ex approval 49
Certification PROFIBUS 50
Modbus RS485 certification 50
EtherNet/IP certification 50
Other standards and guidelines 50

Ordering information 51

Application packages 51
Heartbeat Technology 51
Concentration 51

Accessories 52
Communication-specific accessories 52
Service-specific accessories 52

Documentation 53
Standard documentation 53
Supplementary device-dependent documentation 53

Registered trademarks 54

Document information

Symbols used

Electrical symbols

Symbol	Meaning	Symbol	Meaning
⎓	Direct current	~	Alternating current
⎓~	Direct current and alternating current	⏚	**Ground connection** A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.
⊜	**Protective ground connection** A terminal which must be connected to ground prior to establishing any other connections.	⏚	**Equipotential connection** A connection that has to be connected to the plant grounding system: This may be a potential equalization line or a star grounding system depending on national or company codes of practice.

Symbols for certain types of information

Symbol	Meaning
✓	**Permitted** Procedures, processes or actions that are permitted.
✓✓	**Preferred** Procedures, processes or actions that are preferred.
✗	**Forbidden** Procedures, processes or actions that are forbidden.
ℹ	**Tip** Indicates additional information.
📖	Reference to documentation
📄	Reference to page
🖼	Reference to graphic
👁	Visual inspection

Symbols in graphics

Symbol	Meaning	Symbol	Meaning
1, 2, 3,...	Item numbers	1., 2., 3., ...	Series of steps
A, B, C, ...	Views	A-A, B-B, C-C, ...	Sections
EX	Hazardous area	EX	Safe area (non-hazardous area)
≋➡	Flow direction		

Function and system design

Measuring principle

The measuring principle is based on the controlled generation of Coriolis forces. These forces are always present in a system when both translational and rotational movements are superimposed.

$F_c = 2 \cdot \Delta m\ (v \cdot \omega)$

F_c = Coriolis force

Δm = moving mass

ω = rotational velocity

v = radial velocity in rotating or oscillating system

The amplitude of the Coriolis force depends on the moving mass Δm, its velocity v in the system and thus on the mass flow. Instead of a constant rotational velocity ω, the sensor uses oscillation.

Density measurement
The measuring tube is continuously excited at its resonance frequency. A change in the mass and thus the density of the oscillating system (comprising measuring tube and fluid) results in a corresponding, automatic adjustment in the oscillation frequency. Resonance frequency is thus a function of medium density. The microprocessor utilizes this relationship to obtain a density signal.


Temperature measurement
The temperature of the measuring tube is determined in order to calculate the compensation factor due to temperature effects. This signal corresponds to the process temperature and is also available as an output signal.


Measuring system


The device consists of a transmitter and a sensor. If a device is ordered with Modbus RS485 intrinsically safe, the Safety Barrier Promass 100 is part of the scope of supply and must be implemented to operate the device.

One device version is available: compact version - transmitter and sensor form a mechanical unit.

Transmitter


A0016693



A0016694


A0016695


Device versions and materials:
- Compact, aluminum coated:
  Aluminum, AlSi10Mg, coated
- Compact, stainless:
  Stainless steel 1.4301 (304)
- Ultra-compact, stainless:
  Stainless steel 1.4301 (304)

Configuration:
- Via operating tools (e.g. FieldCare)
- Additionally for device version with onsite display:
  Via Web browser (e.g. Microsoft Internet Explorer)
- Also for device version with 4-20 mA HART, pulse/frequency/switch output:
  Via Web browser (e.g. Microsoft Internet Explorer)
- Also for device version with EtherNet/IP output:
  - Via Web browser (e.g. Microsoft Internet Explorer)
  - Via Add-on Profile Level 3 for automation system from Rockwell Automation
  - Via Electronic Data Sheet (EDS)


Sensor

Promass G  A0022407	▪ Simultaneous measurement of flow, density and temperature (multivariable) ▪ Immune to process influences ▪ Nominal diameter range: DN 8 to 25 (3/8 to 1") ▪ Materials: – Sensor: stainless steel, 1.4301 (304) – Measuring tubes: stainless steel, 1.4435 (316L) – Process connections: stainless steel, 1.4404 (316/316L) ▪ Limiting medium pressure range: max. 350 bar (5 080 psi)

Safety Barrier Promass 100

 A0016763	▪ Dual-channel safety barrier for installation in non-hazardous area or Zone 2/Div. 2: – Channel 1: DC 24 V power supply – Channel 2: Modbus RS485 ▪ In addition to current, voltage and power limitation, it offers galvanic isolation of circuits for explosion protection. ▪ Easy DIN rail mounting (DIN 35mm) for installation in control cabinets

Device architecture

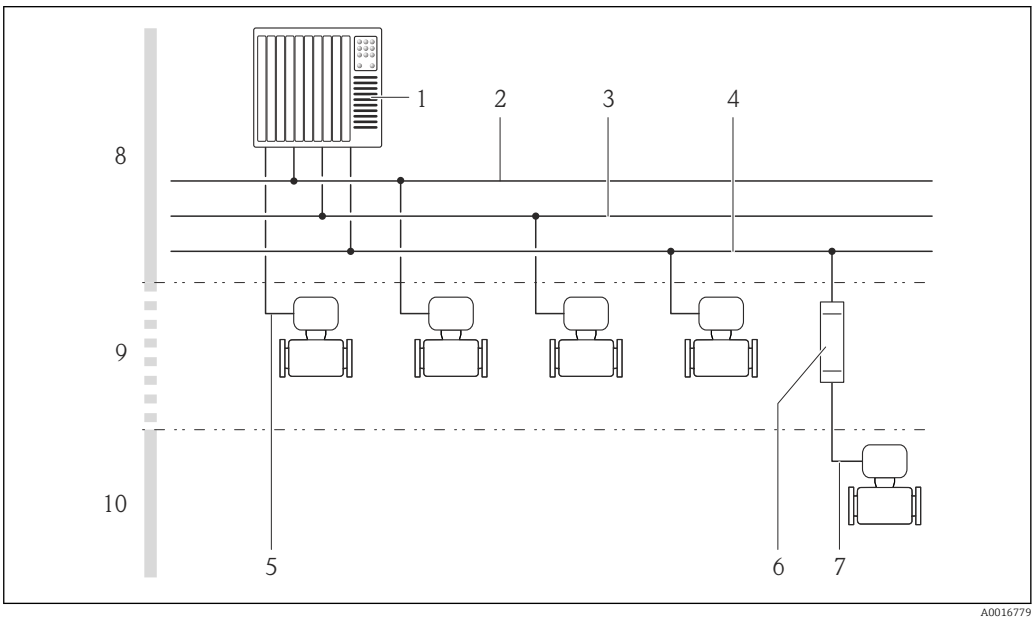

A0016779

1 *Possibilities for integrating measuring devices into a system*

1 *Control system (e.g. PLC)*
2 *EtherNet/IP*
3 *PROFIBUS DP*
4 *Modbus RS485*
5 *4-20 mA HART, pulse/frequency/switch output*
6 *Safety Barrier Promass 100*
7 *Modbus RS485 intrinsically safe*
8 *Non-hazardous area*
9 *Non-hazardous area and Zone 2/Div. 2*
10 *Intrinsically safe area and Zone 1/Div. 1*

Safety

IT security

We only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the device settings.

IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.

Input

Measured variable

Direct measured variables

- Mass flow
- Density
- Temperature

Calculated measured variables

- Volume flow
- Corrected volume flow
- Reference density

Measuring range

Measuring ranges for liquids

DN		Measuring range full scale values $\dot{m}_{min(F)}$ to $\dot{m}_{max(F)}$	
[mm]	[in]	[kg/h]	[lb/min]
8	3/8	0 to 2 000	0 to 73.50
15	1/2	0 to 6 500	0 to 238.9
25	1	0 to 18 000	0 to 661.5

Measuring ranges for gases

The full scale values depend on the density of the gas and can be calculated with the formula below:
$\dot{m}_{max(G)} = \dot{m}_{max(F)} \cdot \rho_G : x$

$\dot{m}_{max(G)}$	Maximum full scale value for gas [kg/h]
$\dot{m}_{max(F)}$	Maximum full scale value for liquid [kg/h]
$\dot{m}_{max(G)} < \dot{m}_{max(F)}$	$\dot{m}_{max(G)}$ can never be greater than $\dot{m}_{max(F)}$
ρ_G	Gas density in [kg/m³] at operating conditions

DN		x
[mm]	[in]	[kg/m³]
8	3/8	85
15	1/2	110
25	1	125

To calculate the measuring range, use the *Applicator* sizing tool (→ 52)

Recommended measuring range

"Flow limit" section (→ 38)

Operable flow range

Over 1000 : 1.

Flow rates above the preset full scale value are not overridden by the electronics unit, with the result that the totalizer values are registered correctly.

Output

Output signal

Current output

Current output	4-20 mA HART (active)
Maximum output values	▪ DC 24 V (when idle) ▪ 22.5 mA
Load	0 to 700 Ω
Resolution	0.38 µA
Damping	Adjustable: 0.07 to 999 s
Assignable measured variables	▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature The range of options increases if the measuring device has one or more application packages.

Pulse/frequency/switch output

Function	Can be set to pulse, frequency or switch output
Version	Passive, open collector
Maximum input values	▪ DC 30 V ▪ 25 mA
Voltage drop	For 25 mA: ≤ DC 2 V
Pulse output	
Pulse width	Adjustable: 0.05 to 2 000 ms
Maximum pulse rate	10 000 Impulse/s
Pulse value	Adjustable
Assignable measured variables	▪ Mass flow ▪ Volume flow ▪ Corrected volume flow
Frequency output	
Output frequency	Adjustable: 0 to 10 000 Hz
Damping	Adjustable: 0 to 999 s
Pulse/pause ratio	1:1
Assignable measured variables	▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature The range of options increases if the measuring device has one or more application packages.
Switch output	
Switching behavior	Binary, conductive or non-conductive
Switching delay	Adjustable: 0 to 100 s

Number of switching cycles	Unlimited
Assignable functions	▪ Off ▪ On ▪ Diagnostic behavior ▪ Limit value – Mass flow – Volume flow – Corrected volume flow – Density – Reference density – Temperature – Totalizer 1-3 ▪ Flow direction monitoring ▪ Status – Monitoring of partially filled pipe – Low flow cut off The range of options increases if the measuring device has one or more application packages.

PROFIBUS DP

Signal encoding	NRZ code
Data transfer	9.6 kBaud...12 MBaud

Modbus RS485

Physical interface	In accordance with EIA/TIA-485-A standard
Terminating resistor	▪ For device version used in non-hazardous areas or Zone 2/Div. 2: integrated and can be activated via DIP switches on the transmitter electronics module ▪ For device version used in intrinsically safe areas: integrated and can be activated via DIP switches on the Safety Barrier Promass 100

EtherNet/IP

Standards	In accordance with IEEE 802.3

Signal on alarm

Depending on the interface, failure information is displayed as follows:

Current output

4-20 mA

Failsafe mode	Selectable (as per NAMUR recommendation NE 43): ▪ Minimum value: 3.6 mA ▪ Maximum value: 22 mA ▪ Defined value: 3.59 to 22.5 mA ▪ Actual value ▪ Last valid value

HART

Device diagnostics	Device condition can be read out via HART Command 48

Pulse/frequency/switch output

Pulse output	
Failsafe mode	Choose from: ▪ Actual value ▪ No pulses
Frequency output	
Failsafe mode	Choose from: ▪ Actual value ▪ Defined value: 0 to 12 500 Hz ▪ 0 Hz
Switch output	
Failsafe mode	Choose from: ▪ Current status ▪ Open ▪ Closed

PROFIBUS DP

Status and alarm messages	Diagnostics in accordance with PROFIBUS PA Profile 3.02

Modbus RS485

Failsafe mode	Choose from: ▪ NaN value instead of current value ▪ Last valid value

EtherNet/IP

Device diagnostics	Device condition can be read out in Input Assembly

Local display

Plain text display	With information on cause and remedial measures
Backlight	Red backlighting indicates a device error.

Status signal as per NAMUR recommendation NE 107

Operating tool

- Via digital communication:
  - HART protocol
  - PROFIBUS DP
  - Modbus RS485
  - EtherNet/IP
- Via service interface

Plain text display	With information on cause and remedial measures

Additional information on remote operation (→ 46)

Web browser

Plain text display	With information on cause and remedial measures

Light emitting diodes (LED)

Status information	Status indicated by various light emitting diodes The following information is displayed depending on the device version: ▪ Supply voltage active ▪ Data transmission active ▪ Device alarm/error has occurred ▪ EtherNet/IP network available ▪ EtherNet/IP connection established

Ex connection data

These values only apply for the following device version:
Order code for "Output", option **M**: Modbus RS485, for use in intrinsically safe areas

Safety Barrier Promass 100

Safety-related values

Terminal numbers			
Supply voltage		**Signal transmission**	
2 (L-)	**1 (L+)**	**26 (A)**	**27 (B)**
U_{nom} = DC 24 V U_{max} = AC 260 V		U_{nom} = DC 5 V U_{max} = AC 260 V	

Intrinsically safe values

Terminal numbers			
Supply voltage		**Signal transmission**	
20 (L-)	**10 (L+)**	**62 (A)**	**72 (B)**
U_o = 16.24 V I_o = 623 mA P_o = 2.45 W For IIC*: L_o = 92.8 µH, C_o = 0.433 µF, L_o/R_o = 14.6 µH/Ω			

* The gas group depends on the sensor and nominal diameter.

For an overview and for information on the interdependencies between the gas group - sensor - nominal diameter, see the "Safety Instructions" (XA) document for the measuring device

Transmitter

Intrinsically safe values

Order code for "Approvals"	Terminal numbers			
	Supply voltage		**Signal transmission**	
	20 (L-)	**10 (L+)**	**62 (A)**	**72 (B)**
▪ Option **BM**: ATEX II2G + IECEx Z1 Ex ia, II2D Ex tb ▪ Option **BU**: ATEX II2G + IECEx Z1 Ex ia ▪ Option **C2**: CSA C/US IS Cl. I, II, III Div. 1 ▪ Option **85**: ATEX II2G + IECEx Z1 Ex ia + CSA C/US IS Cl. I, II, III Div. 1	U_i = 16.24 V I_i = 623 mA P_i = 2.45 W L_i = 0 µH C_i = 6 nF			

For an overview and for information on the interdependencies between the gas group - sensor - nominal diameter, see the "Safety Instructions" (XA) document for the measuring device

Low flow cut off

The switch points for low flow cut off are user-selectable.

Galvanic isolation

The following connections are galvanically isolated from each other:
- Outputs
- Power supply

Protocol-specific data

HART

Manufacturer ID	0x11
Device type ID	0x4A
HART protocol revision	7
Device description files (DTM, DD)	Information and files under: www.endress.com
HART load	Min. 250 Ω
Dynamic variables	Read out the dynamic variables: HART command 3 The measured variables can be freely assigned to the dynamic variables. **Measured variables for PV (primary dynamic variable)** ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature **Measured variables for SV, TV, QV (secondary, tertiary and quaternary dynamic variable)** ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature ▪ Totalizer 1 ▪ Totalizer 2 ▪ Totalizer 3 The range of options increases if the measuring device has one or more application packages. **Heartbeat Technology Application Package** Additional measured variables are available with the Heartbeat Technology application package: Carrier pipe temperature
Device variables	Read out the device variables: HART command 9 The device variables are permanently assigned. A maximum of 8 device variables can be transmitted: ▪ 0 = mass flow ▪ 1 = volume flow ▪ 2 = corrected volume flow ▪ 3 = density ▪ 4 = reference density ▪ 5 = temperature ▪ 6 = totalizer 1 ▪ 7 = totalizer 2 ▪ 8 = totalizer 3 ▪ 13 = target mass flow ▪ 14 = carrier mass flow ▪ 15 = concentration

PROFIBUS DP

Manufacturer ID	0x11
Ident number	0x1561
Profile version	3.02

Device description files (GSD, DTM, DD)	Information and files under: ▪ www.endress.com On the product page for the device: Documents/Software → Device drivers ▪ www.profibus.org
Output values (from measuring device to automation system)	**Analog input 1 to 8** ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Target mass flow ▪ Carrier mass flow ▪ Density ▪ Reference density ▪ Concentration ▪ Temperature ▪ Carrier pipe temperature ▪ Electronics temperature ▪ Oscillation frequency ▪ Oscillation amplitude ▪ Frequency fluctuation ▪ Oscillation damping ▪ Tube damping fluctuation ▪ Signal asymmetry ▪ Exciter current **Digital input 1 to 2** ▪ Monitoring of partially filled measuring tube ▪ Low flow cut off **Totalizer 1 to 3** ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow
Input values (from automation system to measuring device)	**Analog output 1 to 3 (fixed assignment)** ▪ Pressure ▪ Temperature ▪ Reference density **Digital output 1 to 3 (fixed assignment)** ▪ Digital output 1: switch positive zero return on/off ▪ Digital output 2: perform zero point adjustment ▪ Digital output 3: switch switch output on/off **Totalizer 1 to 3** ▪ Totalize ▪ Reset and hold ▪ Preset and hold ▪ Stop ▪ Operating mode configuration: – Net flow total – Forward flow total – Reverse flow total
Supported functions	▪ Identification & Maintenance Simplest device identification on the part of the control system and nameplate ▪ PROFIBUS upload/download Reading and writing parameters is up to ten times faster with PROFIBUS upload/download ▪ Condensed status Simplest and self-explanatory diagnostic information by categorizing diagnostic messages that occur
Configuration of the device address	▪ DIP switches on the I/O electronics module ▪ Via operating tools (e.g. FieldCare)

Modbus RS485

Protocol	Modbus Applications Protocol Specification V1.1
Device type	Slave

Slave address range	1 to 247
Broadcast address range	0
Function codes	▪ 03: Read holding register ▪ 04: Read input register ▪ 06: Write single registers ▪ 08: Diagnostics ▪ 16: Write multiple registers ▪ 23: Read/write multiple registers
Broadcast messages	Supported by the following function codes: ▪ 06: Write single registers ▪ 16: Write multiple registers ▪ 23: Read/write multiple registers
Supported baud rate	▪ 1 200 BAUD ▪ 2 400 BAUD ▪ 4 800 BAUD ▪ 9 600 BAUD ▪ 19 200 BAUD ▪ 38 400 BAUD ▪ 57 600 BAUD ▪ 115 200 BAUD
Data transfer mode	▪ ASCII ▪ RTU
Data access	Each device parameter can be accessed via Modbus RS485. For Modbus register information

EtherNet/IP

Protocol	▪ The CIP Networks Library Volume 1: Common Industrial Protocol ▪ The CIP Networks Library Volume 2: EtherNet/IP Adaptation of CIP
Communication type	▪ 10Base-T ▪ 100Base-TX
Device profile	Generic device (product type: 0x2B)
Manufacturer ID	0x49E
Device type ID	0x104A
Baud rates	Automatic $^{10}/_{100}$ Mbit with half-duplex and full-duplex detection
Polarity	Auto-polarity for automatic correction of crossed TxD and RxD pairs
Supported CIP connections	Max. 3 connections
Explicit connections	Max. 6 connections
I/O connections	Max. 6 connections (scanner)
Configuration options for measuring device	▪ DIP switches on the electronics module for IP addressing ▪ Manufacturer-specific software (FieldCare) ▪ Add-on Profile Level 3 for Rockwell Automation control systems ▪ Web browser ▪ Electronic Data Sheet (EDS) integrated in the measuring device
Configuration of the EtherNet interface	▪ Speed: 10 MBit, 100 MBit, auto (factory setting) ▪ Duplex: half-duplex, full-duplex, auto (factory setting)
Configuration of the device address	▪ DIP switches on the electronics module for IP addressing (last octet) ▪ DHCP ▪ Manufacturer-specific software (FieldCare) ▪ Add-on Profile Level 3 for Rockwell Automation control systems ▪ Web browser ▪ EtherNet/IP tools, e.g. RSLinx (Rockwell Automation)
Device Level Ring (DLR)	No


Fix Input			
RPI	5 ms to 10 s (factory setting: 20 ms)		
Exclusive Owner Multicast		Instance	Size [byte]
	Instance configuration:	0x68	398
	O → T configuration:	0x66	64
	T → O configuration:	0x64	44
Exclusive Owner Multicast		Instance	Size [byte]
	Instance configuration:	0x69	-
	O → T configuration:	0x66	64
	T → O configuration:	0x64	44
Input only Multicast		Instance	Size [byte]
	Instance configuration:	0x68	398
	O → T configuration:	0xC7	-
	T → O configuration:	0x64	44
Input only Multicast		Instance	Size [byte]
	Instance configuration:	0x69	-
	O → T configuration:	0xC7	-
	T → O configuration:	0x64	44
Input Assembly	▪ Current device diagnostics ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature ▪ Totalizer 1 ▪ Totalizer 2 ▪ Totalizer 3		
Configurable Input			
RPI	5 ms to 10 s (factory setting: 20 ms)		
Exclusive Owner Multicast		Instance	Size [byte]
	Instance configuration:	0x68	398
	O → T configuration:	0x66	64
	T → O configuration:	0x65	88
Exclusive Owner Multicast		Instance	Size [byte]
	Instance configuration:	0x69	-
	O → T configuration:	0x66	64
	T → O configuration:	0x65	88
Input only Multicast		Instance	Size [byte]
	Instance configuration:	0x68	398
	O → T configuration:	0xC7	-
	T → O configuration:	0x65	88
Input only Multicast		Instance	Size [byte]
	Instance configuration:	0x69	-
	O → T configuration:	0xC7	-
	T → O configuration:	0x65	88

Configurable Input Assembly	▪ Current device diagnostics ▪ Mass flow ▪ Volume flow ▪ Corrected volume flow ▪ Density ▪ Reference density ▪ Temperature ▪ Totalizer 1 ▪ Totalizer 2 ▪ Totalizer 3 The range of options increases if the measuring device has one or more application packages.
Fix Output	
Output Assembly	▪ Activation of reset totalizers 1-3 ▪ Activation of pressure compensation ▪ Activation of reference density compensation ▪ Activation of temperature compensation ▪ Reset totalizers 1-3 ▪ External pressure value ▪ Pressure unit ▪ External reference density ▪ Reference density unit ▪ External temperature ▪ Temperature unit
Configuration	
Configuration Assembly	Only the most common configurations are listed below. ▪ Software write protection ▪ Mass flow unit ▪ Mass unit ▪ Volume flow unit ▪ Volume unit ▪ Corrected volume flow unit ▪ Corrected volume unit ▪ Density unit ▪ Reference density unit ▪ Temperature unit ▪ Pressure unit ▪ Length ▪ Totalizer 1-3: – Assignment – Unit – Mode of operation – Failsafe mode ▪ Alarm delay

Power supply

Terminal assignment

Overview: housing version

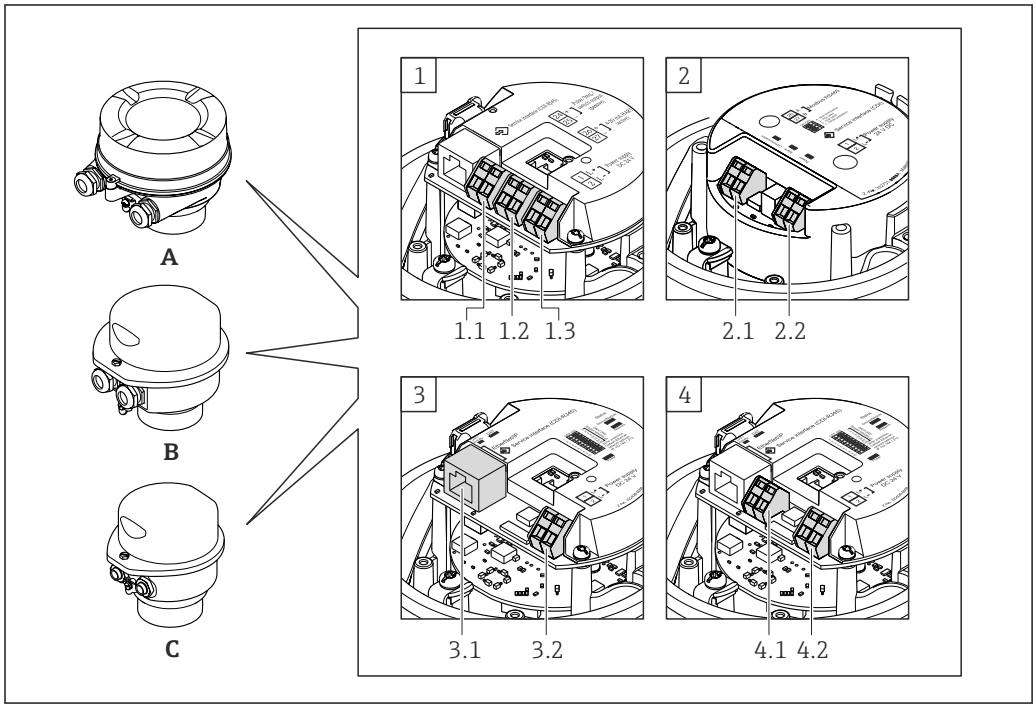

A Housing version: compact, aluminum coated
B Housing version: compact, stainless
C Housing version: ultra-compact, stainless:
1 Connection version: 4-20 mA HART, pulse/frequency/switch output
1.1 Signal transmission: pulse/frequency/switch output
1.2 Signal transmission: 4-20 mA HART
1.3 Supply voltage
2 Connection version: Modbus RS485
2.1 Signal transmission
2.2 Supply voltage
3 Connection version: EtherNet/IP
3.1 Signal transmission
3.2 Supply voltage
4 Connection version: PROFIBUS DP
4.1 Signal transmission
4.2 Supply voltage


Transmitter

Connection version 4-20 mA HART with pulse/frequency/switch output

Order code for "Output", option **B**

Depending on the housing version, the transmitters can be ordered with clamps or device plugs.

Order Code "Housing"	Connection methods available		Possible options for order code "Electrical connection"
	Outputs	Power supply	
Options **A**, **B**	Terminals	Terminals	▪ Option **A**: coupling M20x1 ▪ Option **B**: thread M20x1 ▪ Option **C**: thread G ½" ▪ Option **D**: thread NPT ½"
Options **A**, **B**	Device plugs (→ 21)	Terminals	▪ Option **L**: plug M12x1 + thread NPT ½" ▪ Option **N** "Plug M12x1 + coupling M20" ▪ Option **P** "Plug M12x1 + thread G ½" ▪ Option **U** "Plug M12x1 + thread M20"
Options **A**, **B**, **C**	Device plugs (→ 21)	Device plugs (→ 21)	Option **Q** "2 x plug M12x1"
Order code for "Housing": ▪ Option **A**: compact, coated aluminum ▪ Option **B**: compact, stainless ▪ Option **C** "Ultra- compact, stainless"			

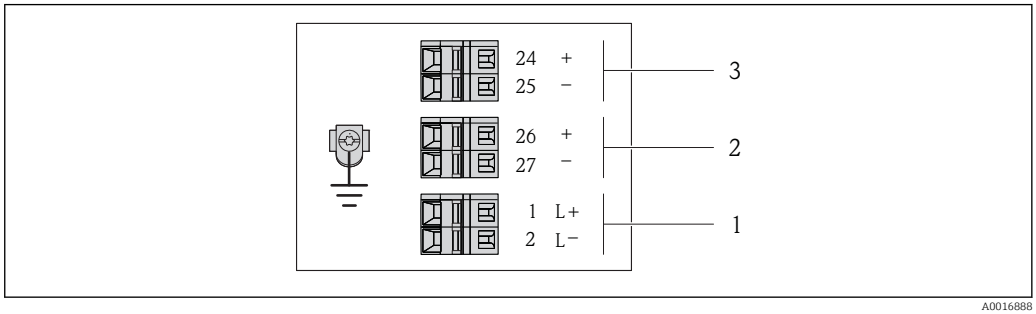

2 *Terminal assignment 4-20 mA HART with pulse/frequency/switch output*

1 *Power supply: DC 24 V*
2 *Output 1: 4-20 mA HART (active)*
3 *Output 2: pulse/frequency/switch output (passive)*

Order Code "Output"	Terminal number					
	Power supply		Output 1		Output 2	
	2 (L-)	1 (L+)	27 (–)	26 (+)	25 (–)	24 (+)
Option **B**	DC 24 V		4-20 mA HART (active)		Pulse/frequency/switch output (passive)	
Order code for "Output": Option **B**: 4-20 mA HART with pulse/frequency/switch output						


PROFIBUS DP connection version

For use in the non-hazardous area and Zone 2/Div. 2.

Order code for "Output", option **L**

Depending on the housing version, the transmitters can be ordered with clamps or device plugs.

Order Code "Housing"	Connection methods available		Possible options for order code "Electrical connection"
	Output	Power supply	
Options **A**, **B**	Terminals	Terminals	▪ Option **A**: coupling M20x1 ▪ Option **B**: thread M20x1 ▪ Option **C**: thread G ½" ▪ Option **D**: thread NPT ½"
Options **A**, **B**	Device plugs (→ 🖹 21)	Terminals	▪ Option **L**: plug M12x1 + thread NPT ½" ▪ Option **N** "Plug M12x1 + coupling M20" ▪ Option **P** "Plug M12x1 + thread G ½" ▪ Option **U** "Plug M12x1 + thread M20"
Options **A**, **B**, **C**	Device plugs (→ 🖹 21)	Device plugs (→ 🖹 21)	Option **Q** "2 x plug M12x1"
Order code for "Housing": ▪ Option **A**: compact, coated aluminum ▪ Option **B**: compact, stainless ▪ Option **C** "Ultra-compact, stainless"			

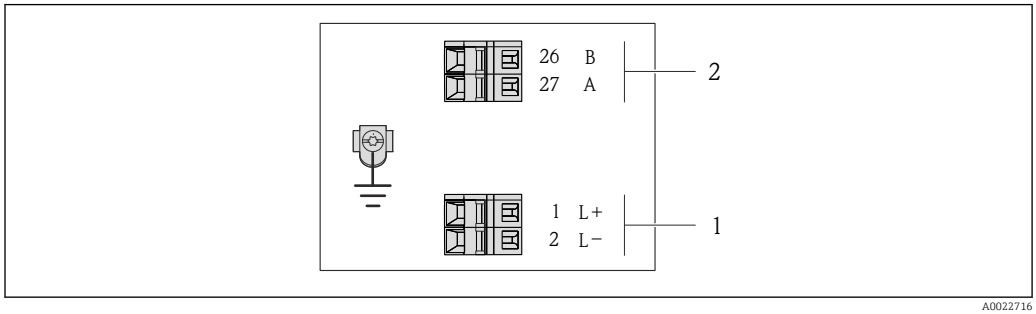

3 PROFIBUS DP terminal assignment

1 Power supply: DC 24 V
2 PROFIBUS DP

Order Code "Output"	Terminal number			
	Power supply		Output	
	2 (L-)	1 (L+)	26 (RxD/TxD-P)	27 (RxD/TxD-N)
Option **L**	DC 24 V		B	A
Order code for "Output": Option **L**: PROFIBUS DP, for use in non-hazardous areas and Zone 2/div. 2				


Modbus RS485 connection version

For use in the non-hazardous area and Zone 2/Div. 2.

Order code for "Output", option **M**

Depending on the housing version, the transmitters can be ordered with clamps or device plugs.

Order Code "Housing"	Connection methods available		Possible options for order code "Electrical connection"
	Output	Power supply	
Options **A**, **B**	Terminals	Terminals	▪ Option **A**: coupling M20x1 ▪ Option **B**: thread M20x1 ▪ Option **C**: thread G ½" ▪ Option **D**: thread NPT ½"
Options **A**, **B**	Device plugs (→ 21)	Terminals	▪ Option **L**: plug M12x1 + thread NPT ½" ▪ Option **N** "Plug M12x1 + coupling M20" ▪ Option **P** "Plug M12x1 + thread G ½" ▪ Option **U** "Plug M12x1 + thread M20"
Options **A**, **B**, **C**	Device plugs (→ 21)	Device plugs (→ 21)	Option **Q** "2 x plug M12x1"
Order code for "Housing": ▪ Option **A**: compact, coated aluminum ▪ Option **B**: compact, stainless ▪ Option **C** "Ultra- compact, stainless"			

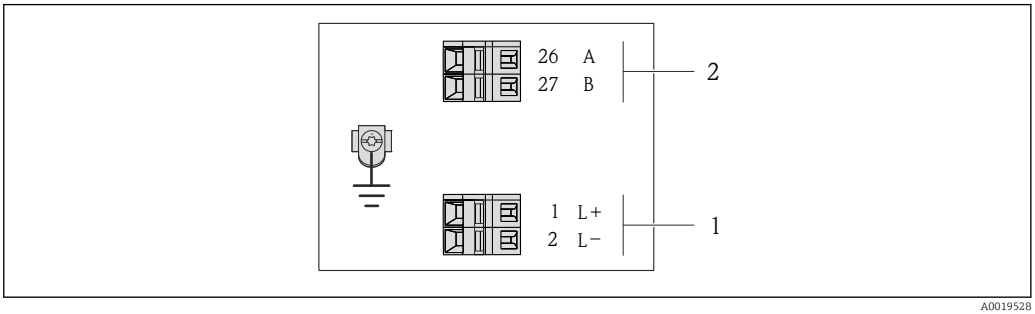

4 *Modbus RS485 terminal assignment, connection version for use in non-hazardous areas and Zone 2/Div. 2*

1 *Power supply: DC 24 V*
2 *Modbus RS485*

Order Code "Output"	Terminal number			
	Power supply		Output	
	2 (L-)	1 (L+)	27 (B)	26 (A)
Option **M**	DC 24 V		Modbus RS485	
Order code for "Output": Option **M** "Modbus RS485", for use in non-hazardous areas and Zone 2/Div. 2				


Modbus RS485 connection version

For use in the intrinsically safe area. Connection via Safety Barrier Promass 100.

Order code for "Output", option **M**

Depending on the housing version, the transmitters can be ordered with clamps or device plugs.

Order Code "Housing"	Connection methods available		Possible options for order code "Electrical connection"
	Output	Power supply	
Options **A**, **B**	Terminals	Terminals	▪ Option **A**: coupling M20x1 ▪ Option **B**: thread M20x1 ▪ Option **C**: thread G ½" ▪ Option **D**: thread NPT ½"
A, **B**, **C**	Device plugs (→ 🖹 21)		Option **I** "Plug M12x1"
Order code for "Housing": ▪ Option **A**: compact, coated aluminum ▪ Option **B**: compact, stainless ▪ Option **C** "Ultra-compact, stainless"			

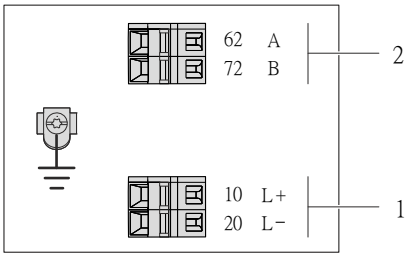

A0017053

5 Modbus RS485 terminal assignment, connection version for use in intrinsically safe areas (connection via Safety Barrier Promass 100)

1 Intrinsically safe power supply
2 Modbus RS485


Order Code "Output"	20 (L-)	10 (L+)	72 (B)	62 (A)
Option **M**	Intrinsically safe supply voltage		Modbus RS485 intrinsically safe	
Order code for "Output": Option **M**: Modbus RS485, for use in intrinsically safe areas (connection via Safety Barrier Promass 100)				

EtherNet/IP connection version

Order code for "Output", option **N**

Depending on the housing version, the transmitters can be ordered with clamps or device plugs.

Order Code "Housing"	Connection methods available		Possible options for order code "Electrical connection"
	Output	Power supply	
Options **A**, **B**	Device plugs (→ 🖹 21)	Terminals	▪ Option **L**: plug M12x1 + thread NPT ½" ▪ Option **N** "Plug M12x1 + coupling M20" ▪ Option **P** "Plug M12x1 + thread G ½" ▪ Option **U** "Plug M12x1 + thread M20"
Options **A**, **B**, **C**	Device plugs (→ 🖹 21)	Device plugs (→ 🖹 21)	Option **Q** "2 x plug M12x1"
Order code for "Housing": ▪ Option **A**: compact, coated aluminum ▪ Option **B**: compact, stainless ▪ Option **C** "Ultra compact, stainless"			

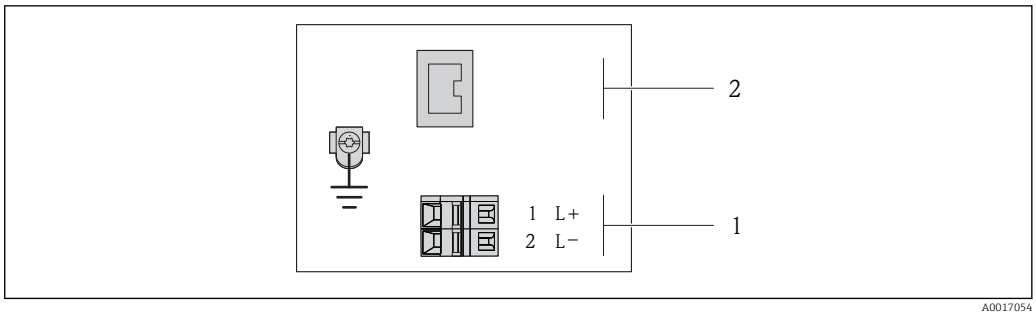


6 *EtherNet/IP terminal assignment*

1 Power supply: DC 24 V
2 EtherNet/IP

Order Code "Output"	Terminal number		
	Power supply		Output
	2 (L-)	1 (L+)	Device plug M12x1
Option **N**	DC 24 V		EtherNet/IP
Order code for "Output": Option **N**: EtherNet/IP			

Safety Barrier Promass 100

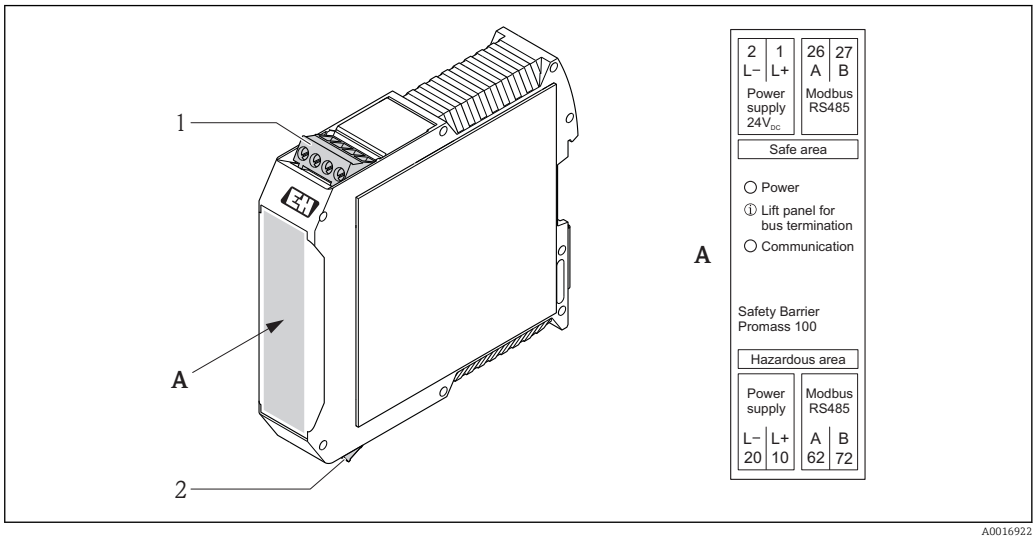

7 *Safety Barrier Promass 100 with terminals*

1 Non-hazardous area and Zone 2/Div. 2
2 Intrinsically safe area


Pin assignment, device plug

Order codes for the M12x1 connectors, see the "Order code for **electrical connection**" column:
- 4-20 mA HART, pulse/frequency/switch output (→ 16)
- PROFIBUS DP(→ 17)
- Modbus RS485 (→ 18)
- EtherNet/IP (→ 20)

Supply voltage

For all connection versions except MODBUS RS485 intrinsically safe (device side)

Device plug MODBUS RS485 intrinsically safe with supply voltage (→ 23)




Pin	Assignment	
1	L+	DC 24 V
2		
3		
4	L-	DC 24 V
5		Grounding/shielding
Coding		**Plug/socket**
A		Plug

The following is recommended as a socket:
- Binder, series 763, part no. 79 3440 35 05
- Alternatively: Phoenix part no. 1669767 SAC-5P-M12MS
  - With the Order Code for "Output", Option **B** "4-20 mA HART, pulse/frequency/switch output"
  - With the Order Code for "Output", Option **N** "EtherNet/IP"
- When using the device in a hazardous location: Use a suitably certified socket.

4-20 mA HART with pulse/frequency/switch output

Device plug for signal transmission (device side)




Pin	Assignment	
1	+	4-20 mA HART (active)
2	-	4-20 mA HART (active)
3	+	Pulse/frequency/switch output (passive)
4	-	Pulse/frequency/switch output (passive)
5		Grounding/shielding
Coding		**Plug/socket**
A		Socket

- Recommended plug: Binder, series 763, part no. 79 3439 12 05
- When using the device in a hazardous location, use a suitably certified plug.

PROFIBUS DP

For use in the non-hazardous area and Zone 2/Div. 2.

Device plug for signal transmission (device side)




Pin	Assignment	
1		
2	A	PROFIBUS DP
3		
4	B	PROFIBUS DP
5		Grounding/shielding
Coding		**Plug/socket**
B		Socket

- Recommended plug: Binder, series 763, part no. 79 4449 20 05
- When using the device in a hazardous location, use a suitably certified plug.

MODBUS RS485

Device plug for signal transmission with supply voltage (device side), MODBUS RS485 (intrinsically safe)

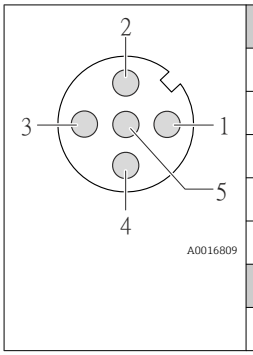


Pin		Assignment
1	L+	Supply voltage, intrinsically safe
2	A	Modbus RS485 intrinsically safe
3	B	
4	L-	Supply voltage, intrinsically safe
5		Grounding/shielding
Coding		**Plug/socket**
A		Plug

- Recommended socket: Binder, series 763, part no. 79 3439 12 05
- When using the device in a hazardous location: Use a suitably certified socket.

Device plug for signal transmission (device side), MODBUS RS485 (not intrinsically safe)

For use in the non-hazardous area and Zone 2/Div. 2.

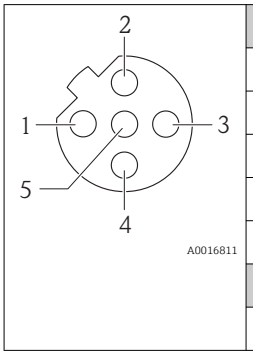


Pin		Assignment
1		
2	A	Modbus RS485
3		
4	B	Modbus RS485
5		Grounding/shielding
Coding		**Plug/socket**
B		Socket

- Recommended plug: Binder, series 763, part no. 79 4449 20 05
- When using the device in a hazardous location, use a suitably certified plug.

EtherNet/IP

Device plug for signal transmission (device side)

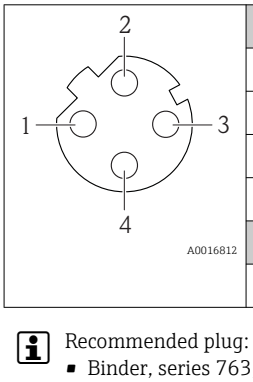

Pin		Assignment
1	+	Tx
2	+	Rx
3	-	Tx
4	-	Rx
Coding		**Plug/socket**
D		Socket

Recommended plug:
- Binder, series 763, part no. 99 3729 810 04
- Phoenix, part no. 1543223 SACC-M12MSD-4Q
- When using the device in a hazardous location, use a suitably certified plug.

Supply voltage

Transmitter

- For device version with all communication types except Modbus RS485 intrinsically safe: DC 20 to 30 V
- For device version with Modbus RS485 intrinsically safe: power supply via Safety Barrier Promass 100

The power unit must be tested to ensure it meets safety requirements (e.g. PELV, SELV).

Safety Barrier Promass 100

DC 20 to 30 V

Power consumption

Transmitter

Order code for "Output"	Maximum power consumption
Option **B**: 4-20 mA HART with pulse/frequency/ switch output	3.5 W
Option **L**: PROFIBUS DP	3.5 W
Option **M** "Modbus RS485", for use in non-hazardous areas and Zone 2/Div. 2	3.5 W
Option **M**: Modbus RS485, for use in intrinsically safe areas	2.45 W
Option **N**: EtherNet/IP	3.5 W

Safety Barrier Promass 100

Order Code "Output"	Maximum Power consumption
Option **M**: Modbus RS485, for use in intrinsically safe areas	4.8 W

Current consumption

Transmitter

Order Code "Output"	Maximum Current consumption	Maximum switch-on current
Option **B**: 4-20mA HART, pul./freq./switch output	145 mA	18 A (<0.125 ms)
Option **L**: PROFIBUS DP	145 mA	18 A (<0.125 ms)
Option **M** "Modbus RS485", for use in non-hazardous areas and Zone 2/Div. 2	90 mA	10 A (<0.8 ms)
Option **M**: Modbus RS485, for use in intrinsically safe areas	145 mA	16 A (<0.4 ms)
Option **N**: EtherNet/IP	145 mA	18 A (<0.125 ms)

Safety Barrier Promass 100


Order Code "Output"	Maximum Current consumption	Maximum switch-on current
Option **M**: Modbus RS485, for use in intrinsically safe areas	230 mA	10 A (<0.8 ms)

Power supply failure

- Totalizers stop at the last value measured.
- Depending on the device version, the configuration is retained in the device memory or in the plug-in memory (HistoROM DAT).
- Error messages (incl. total operated hours) are stored.

Electrical connection

Connecting the transmitter

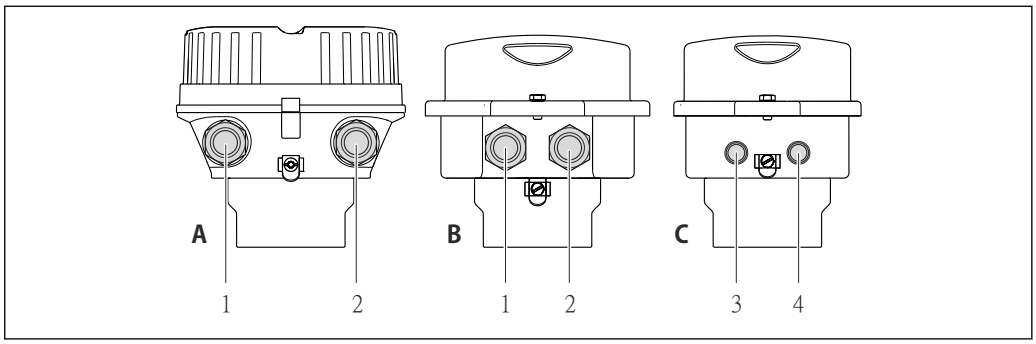

A0016924


A Housing version: compact, aluminum coated
B Housing version: compact, stainless
1 Cable entry or device plug for signal transmission
2 Cable entry or device plug for supply voltage
C Housing version: ultra-compact, stainless
3 Device plug for signal transmission
4 Device plug for supply voltage

Terminal assignment (→ 16)

In the case of device versions with a connector, the transmitter housing does not need to be opened to connect the signal cable or power supply cable.

Connection examples

Current output 4-20 mA HART

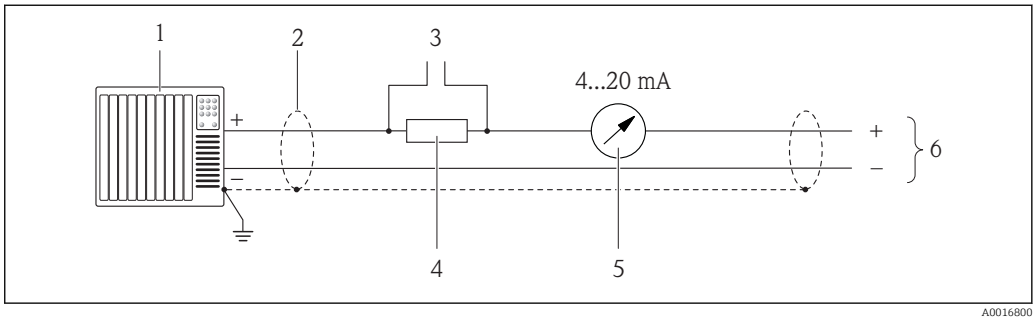


A0016800

8 Connection example for 4-20 mA HART current output (active)

1 Automation system with current input (e.g. PLC)
2 Cable shield, observe cable specifications (→ 29)
3 Connection for HART operating devices (→ 46)
4 Resistor for HART communication (≥ 250 Ω): observe maximum load
5 Analog display unit: observe maximum load
6 Transmitter


Pulse/frequency output

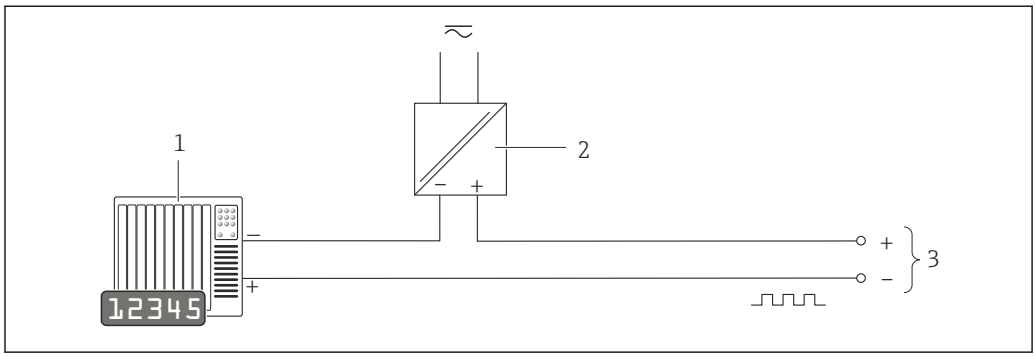

9 Connection example for pulse/frequency output (passive)

1 Automation system with pulse/frequency input (e.g. PLC)
2 Power supply
3 Transmitter: observe input values

PROFIBUS DP

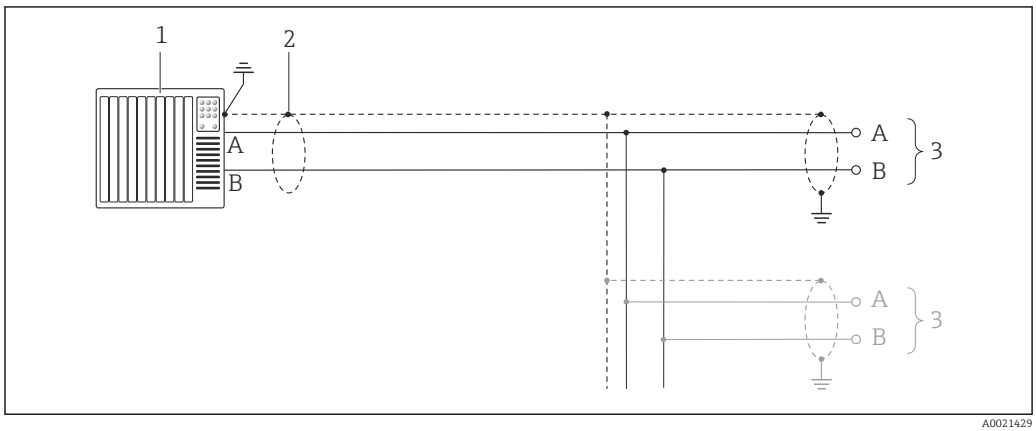


10 Connection example for PROFIBUS DP, non-hazardous area and Zone 2/Div. 2

1 Control system (e.g. PLC)
2 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications (→ 29)
3 Transmitter

If baud rates > 1.5 MBaud an EMC cable entry must be used and the cable shield must continue as far as the terminal wherever possible.


Modbus RS485

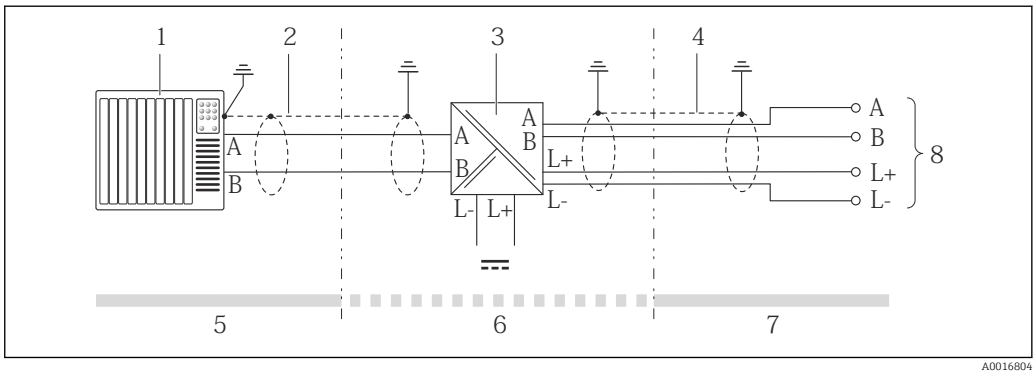

11 Connection example for Modbus RS485 intrinsically safe

1 *Control system (e.g. PLC)*
2 *Cable shield, observe cable specifications (→ 29)*
3 *Safety Barrier Promass 100*
4 *Observe cable specifications (→ 29)*
5 *Non-hazardous area*
6 *Non-hazardous area and Zone 2/Div. 2*
7 *Intrinsically safe area*
8 *Transmitter*


EtherNet/IP

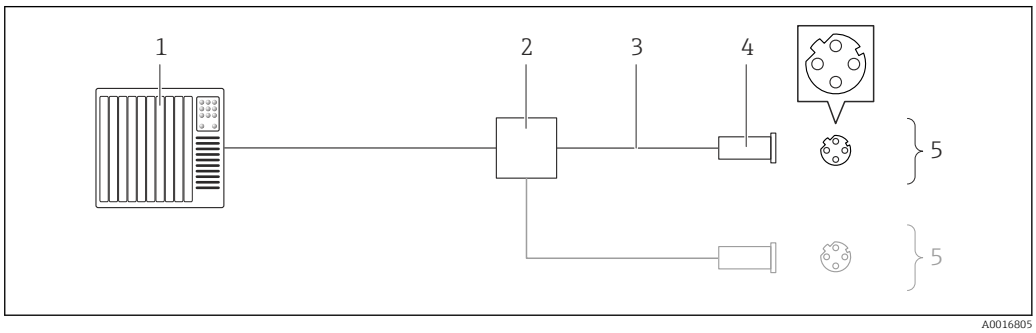

12 Connection example for EtherNet/IP


1 *Control system (e.g. PLC)*
2 *Ethernet switch*
3 *Observe cable specifications (→ 30)*
4 *Device plugs*
5 *Transmitter*

HART input

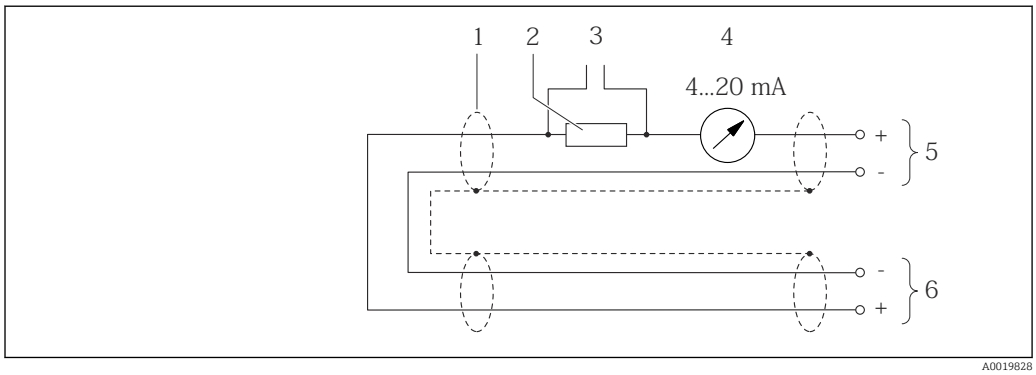

13 Connection example for HART input (burst mode) via current output (active)

1 *Cable shield, observe cable specifications (→ 29)*
2 *Resistor for HART communication (≥ 250 Ω): observe maximum load*
3 *Connection for HART operating devices (→ 46)*
4 *Analog display unit*
5 *Transmitter*
6 *Sensor for external measured variable*

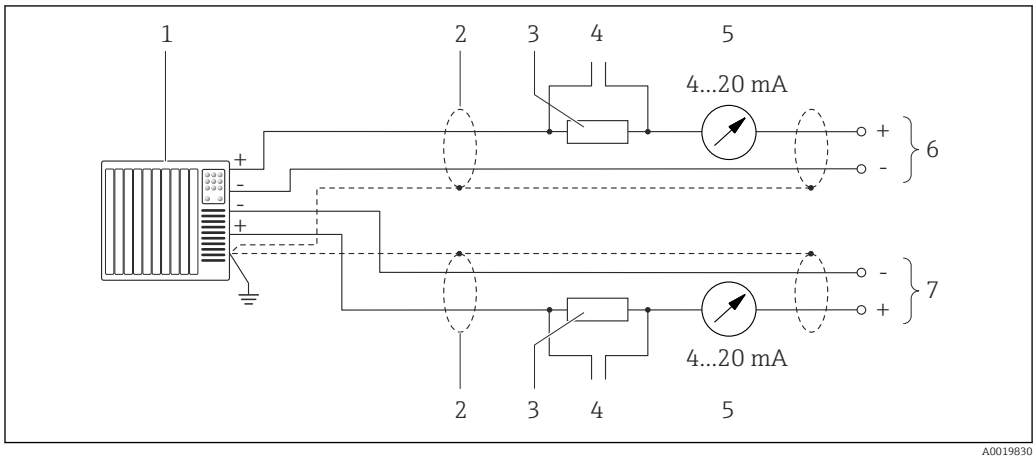

14 Connection example for HART input (master mode) via current output (active)

1 *Automation system with current input (e.g. PLC).*
Prerequisite: automation system with HART version 6, HART commands 113 and 114 can be processed.
2 *Cable shield, observe cable specifications (→ 29)*
3 *Resistor for HART communication (≥ 250 Ω): observe maximum load*
4 *Connection for HART operating devices (→ 46)*
5 *Analog display unit*
6 *Transmitter*
7 *Sensor for external measured variable*

Potential equalization

No special measures for potential equalization are required.

For devices intended for use in hazardous locations, please observe the guidelines in the Ex documentation (XA).

Terminals

Transmitter
Spring terminals for wire cross-sections0.5 to 2.5 mm² (20 to 14 AWG)

Safety Barrier Promass 100
Plug-in screw terminals for wire cross-sections0.5 to 2.5 mm² (20 to 14 AWG)

Cable entries

- Cable gland: M20 × 1.5 with cable Φ6 to 12 mm (0.24 to 0.47 in)
- Thread for cable entry:
  - NPT ½"
  - G ½"
  - M20

Cable specification

Permitted temperature range

- −40 °C (−40 °F) to +80 °C (+176 °F)
- Minimum requirement: cable temperature range ≥ ambient temperature +20 K

Power supply cable

Standard installation cable is sufficient.

Signal cable

Current output

- For 4-20 mA: standard installation cable is sufficient.
- For 4-20 mA HART: Shielded cable recommended. Observe grounding concept of the plant.

Pulse/frequency/switch output

Standard installation cable is sufficient.

PROFIBUS DP

The IEC 61158 standard specifies two types of cable (A and B) for the bus line which can be used for every transmission rate. Cable type A is recommended.

Cable type	A
Characteristic impedance	135 to 165 Ω at a measuring frequency of 3 to 20 MHz
Cable capacitance	<30 pF/m
Wire cross-section	>0.34 mm^2 (22 AWG)
Cable type	Twisted pairs
Loop resistance	≤110 Ω/km
Signal damping	Max. 9 dB over the entire length of the cable cross-section
Shielding	Copper braided shielding or braided shielding with foil shield. When grounding the cable shield, observe the grounding concept of the plant.

Modbus RS485

The EIA/TIA-485 standard specifies two types of cable (A and B) for the bus line which can be used for every transmission rate. Cable type A is recommended.

Cable type	A
Characteristic impedance	135 to 165 Ω at a measuring frequency of 3 to 20 MHz
Cable capacitance	<30 pF/m
Wire cross-section	>0.34 mm^2 (22 AWG)
Cable type	Twisted pairs
Loop resistance	≤110 Ω/km
Signal damping	Max. 9 dB over the entire length of the cable cross-section
Shielding	Copper braided shielding or braided shielding with foil shield. When grounding the cable shield, observe the grounding concept of the plant.

EtherNet/IP

The standard ANSI/TIA/EIA-568-B.2 Annex specifies CAT 5 as the minimum category for a cable used for EtherNet/IP. CAT 5e and CAT 6 are recommended.

For more information on planning and installing EtherNet/IP networks, please refer to the "Media Planning and Installation Manual. EtherNet/IP" of the ODVA Organization.

Connecting cable between Safety Barrier Promass 100 and measuring device

Cable type	Shielded twisted-pair cable with 2x2 wires. When grounding the cable shield, observe the grounding concept of the plant.
Maximum cable resistance	2.5 Ω, one side

▶ Comply with the maximum cable resistance specifications to ensure the operational reliability of the measuring device.

The maximum cable length for individual wire cross-sections is specified in the table below. Observe the maximum capacitance and inductance per unit length of the cable and connection values for hazardous areas (→ 10).

Wire cross-section		Maximum cable length	
[mm²]	[AWG]	[m]	[ft]
0.5	20	70	230
0.75	18	100	328
1.0	17	100	328
1.5	16	200	656
2.5	14	300	984

Performance characteristics

Reference operating conditions

- Error limits based on ISO 11631
- Water with +15 to +45 °C (+59 to +113 °F) at2 to 6 bar (29 to 87 psi)
- Specifications as per calibration protocol
- Accuracy based on accredited calibration rigs that are traced to ISO 17025.

To obtain measured errors, use the *Applicator* sizing tool (→ 52)

Maximum measured error

o.r. = of reading; 1 g/cm³ = 1 kg/l; T = medium temperature

Base accuracy

Mass flow and volume flow (liquids)
±0.15 % o.r.

Mass flow (gases)
±0.75 % o.r.

Design fundamentals (→ 32)

Density (liquids)
- Reference conditions:±0.0005 g/cm³
- Standard density calibration:±0.02 g/cm³
  (valid over the entire temperature range and density range)

Temperature
±0.5 °C ± 0.005 · T °C (±0.9 °F ± 0.003 · (T − 32) °F)

Zero point stability

DN		Zero point stability	
[mm]	[in]	[kg/h]	[lb/min]
8	3/8	0.20	0.007
15	½	0.65	0.024
25	1	1.80	0.066

Flow values

Flow values as turndown parameter depending on nominal diameter.

SI units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[mm]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]
8	2 000	200	100	40	20	4
15	6 500	650	325	130	65	13
25	18 000	1 800	900	360	180	36

US units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[inch]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]
3/8	73.50	7.350	3.675	1.470	0.735	0.147
½	238.9	23.89	11.95	4.778	2.389	0.478
1	661.5	66.15	33.08	13.23	6.615	1.323

Accuracy of outputs

o.r. = of reading

The output accuracy must be factored into the measured error if analog outputs are used, but can be ignored for fieldbus outputs (e.g. Modbus RS485, EtherNet/IP).

Current output

Accuracy	Max. ±5 µA

Pulse/frequency output

Accuracy	Max. ±50 ppm o.r. (across the complete ambient temperature range)

Repeatability

o.r. = of reading; 1 g/cm³ = 1 kg/l; T = medium temperature

Base repeatability

Mass flow and volume flow (liquids)
±0.075 % o.r.

Mass flow (gases)
±0.35 % o.r.

Design fundamentals (→ 32)

Density (liquids)
±0.00025 g/cm³

Temperature
±0.25 °C ± 0.0025 · T °C (±0.45 °F ± 0.0015 · (T−32) °F)

Response time

The response time depends on the configuration (damping).

Influence of ambient temperature

o.r. = of reading

Current output

Temperature coefficient	Max. ±0.005% o.r./°C


Pulse/frequency output

Temperature coefficient	No additional effect. Included in accuracy.

Influence of medium temperature

Mass flow
When there is a difference between the temperature for zero point adjustment and the process temperature, the typical measured error of the sensor is ±0.0003 % of the full scale value/°C (±0.00015 % of the full scale value/°F).

Density
When there is a difference between the density calibration temperature and the process temperature, the typical measured error of the sensor is ±0.0001 g/cm³ /°C (±0.00005 g/cm³ /°F). Field density calibration is possible.

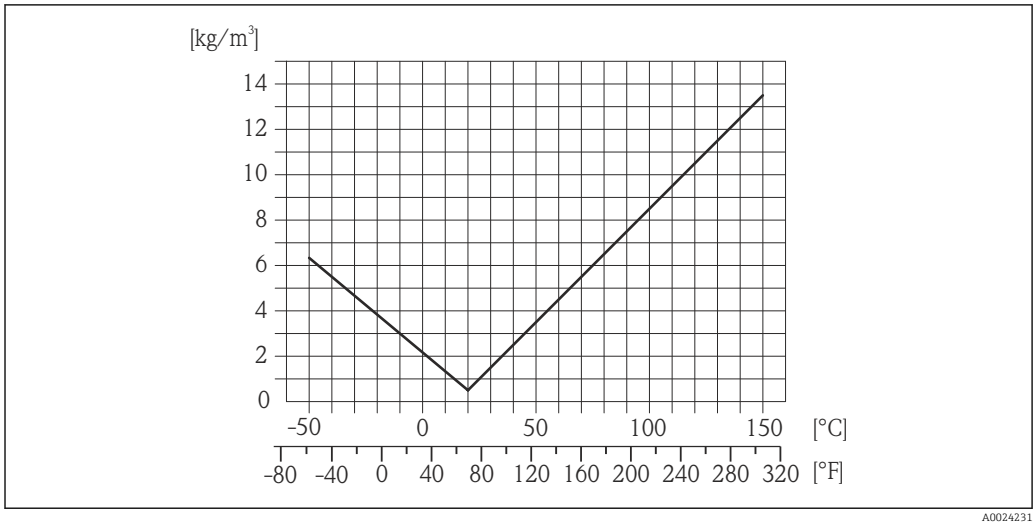

15 Field density calibration, for example at +20 °C (+68 °F)

Temperature
±0.005 · T °C (±0.005 · (T − 32) °F)

Influence of medium pressure

A difference between the calibration pressure and process pressure does not affect accuracy.

Design fundamentals

o.r. = of reading, o.f.s. = of full scale value

BaseAccu = base accuracy in % o.r., BaseRepeat = base repeatability in % o.r.

MeasValue = measured value; ZeroPoint = zero point stability


Calculation of the maximum measured error as a function of the flow rate

Flow rate	Maximum measured error in % o.r.
$\geq \frac{\text{ZeroPoint}}{\text{BaseAccu}} \cdot 100$ A0021332	$\pm$ BaseAccu A0021339
$< \frac{\text{ZeroPoint}}{\text{BaseAccu}} \cdot 100$ A0021333	$\pm \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$ A0021334

Calculation of the maximum repeatability as a function of the flow rate

Flow rate	Maximum repeatability in % o.r.
$\geq \frac{½ \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$ A0021335	$\pm$ BaseRepeat A0021340
$< \frac{½ \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$ A0021336	$\pm ½ \cdot \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$ A0021337

Example for max. measured error

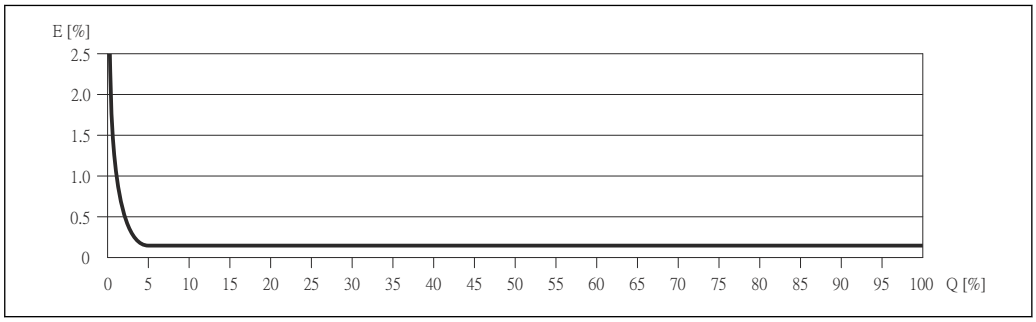

A0019869

E Error: Maximum measured error as % o.r. (example)
Q Flow rate as %


Design fundamentals (→ 32)

Installation

No special measures such as supports are necessary. External forces are absorbed by the construction of the device.





Mounting location

To prevent measuring errors arising from accumulation of gas bubbles in the measuring tube, avoid the following mounting locations in the pipe:
- Highest point of a pipeline.
- Directly upstream of a free pipe outlet in a down pipe.

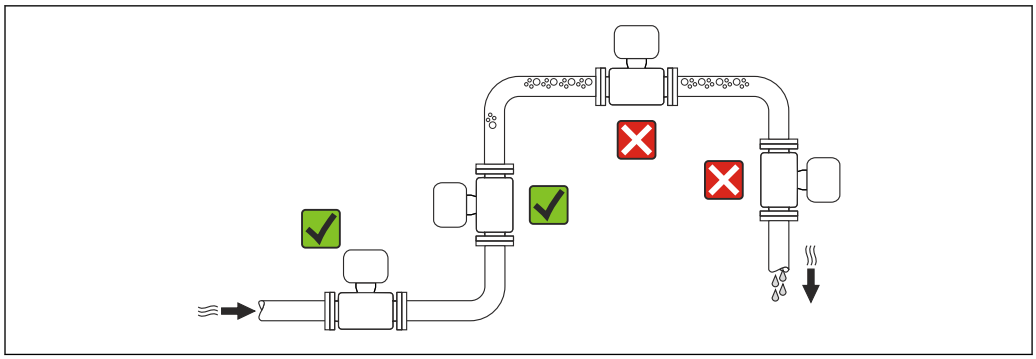


Orientation

The direction of the arrow on the sensor nameplate helps you to install the sensor according to the flow direction (direction of medium flow through the piping).

	Orientation		Recommendation
A	Vertical orientation	 A0015591	✓✓
B	Horizontal orientation, transmitter head up	 A0015589	✓✓ 1) Exception: (→ 16, 34)
C	Horizontal orientation, transmitter head down	 A0015590	✓✓ 2) Exception: (→ 16, 34)
D	Horizontal orientation, transmitter head at side	 A0015592	✗

1) Applications with low process temperatures may reduce the ambient temperature. To maintain the minimum ambient temperature for the transmitter, this orientation is recommended.
2) Applications with high process temperatures may increase the ambient temperature. To maintain the maximum ambient temperature for the transmitter, this orientation is recommended.

If a sensor is installed horizontally with a curved measuring tube, match the position of the sensor to the fluid properties.

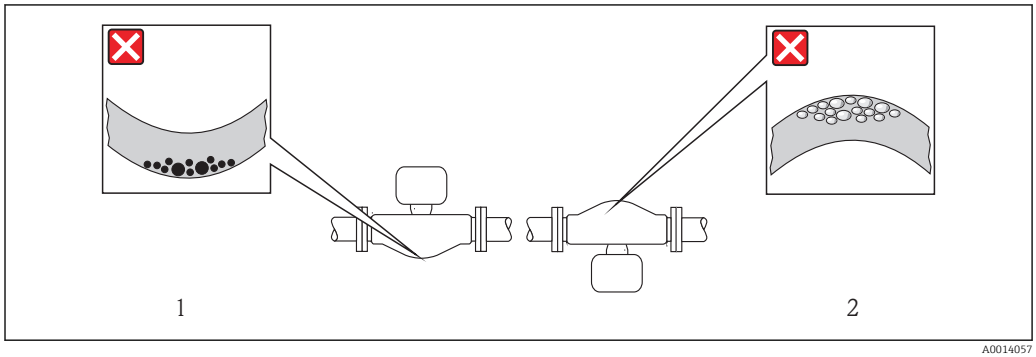

16 *Orientation of sensor with curved measuring tube*

1 *Avoid this orientation for fluids with entrained solids: Risk of solids accumulating.*
2 *Avoid this orientation for outgassing fluids: Risk of gas accumulating.*


Inlet and outlet runs

No special precautions need to be taken for fittings which create turbulence, such as valves, elbows or T-pieces, as long as no cavitation occurs (→ 39).

Special mounting instructions

Rupture disk

Make sure that the function and operation of the rupture disk are not impeded when installing the device. The position of the rupture disk is indicated on a sticker applied over it. If the rupture disk is triggered, the sticker is destroyed. The disk can therefore be visually monitored. For additional information that is relevant to the process (→ 38).

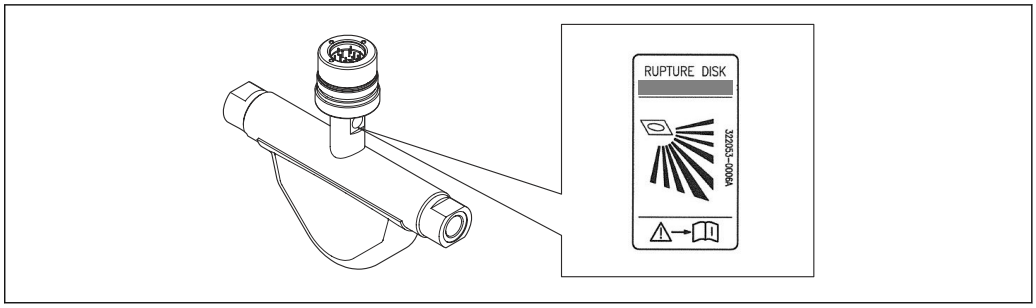


17 *Rupture disk label*

Zero point adjustment

All measuring devices are calibrated in accordance with state-of-the-art technology. Calibration takes place under reference conditions (→ 30). Therefore, a zero point adjustment in the field is generally not required.

Experience shows that zero point adjustment is advisable only in special cases:
- To achieve maximum measuring accuracy even with low flow rates
- Under extreme process or operating conditions (e.g. very high process temperatures or very high-viscosity fluids).

Mounting Safety Barrier Promass 100

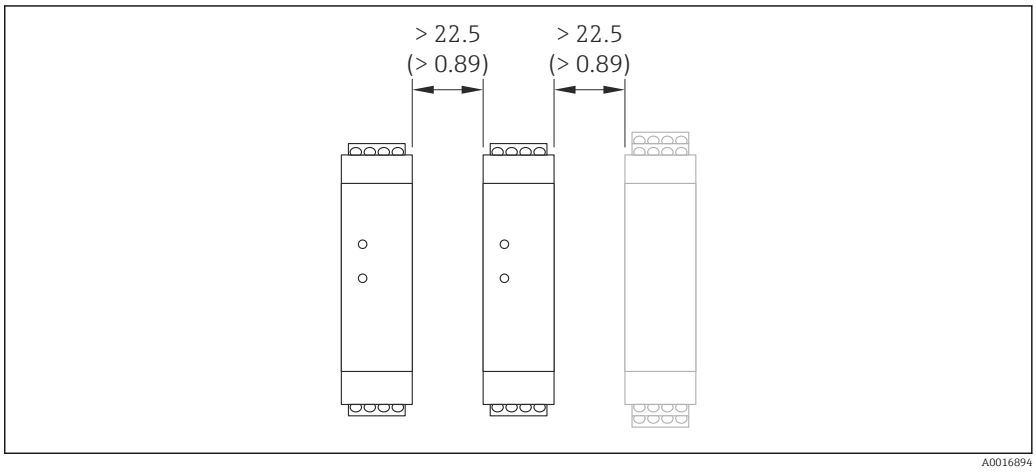

18 *Minimum distance between additional Safety Barrier Promass 100 or other modules.Engineering unit mm (in)*

Environment

Ambient temperature range

Measuring device	Non-Ex	−40 to +60 °C (−40 to +140 °F)
	Ex na, NI version	−40 to +60 °C (−40 to +140 °F)
	Ex ia, IS version	▪ −40 to +60 °C (−40 to +140 °F) ▪ −50 to +60 °C (−58 to +140 °F) (Order code for "Test, certificate", option JM)

Local display	−20 to +60 °C (−4 to +140 °F) The readability of the display may be impaired at temperatures outside the temperature range.
Safety Barrier Promass 100	−40 to +60 °C (−40 to +140 °F)

▶ If operating outdoors:
Avoid direct sunlight, particularly in warm climatic regions.

Weather protection covers can be ordered from Endress+Hauser: see "Accessories" section

Temperature tables

In the following tables, the following interdependencies between the maximum medium temperature for T1 to T6 and the maximum ambient temperature T_a apply when operating the device in hazardous areas.

Ex ia, $_{C}CSA_{US}$ IS

SI units

Order Code for "Housing"	T_a [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
Option A "Compact coated alu" Option B "Compact, stainless"	35	50	85	120	150	150	150
	50	–	85	120	150	150	150
	60	–	–	120	150	150	150
Option C "Ultra-compact, stainless"	35	50	85	120	150	150	150
	45	–	85	120	150	150	150
	50	–	–	120	150	150	150

US units

Order Code for "Housing"	T_a [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
Option A "Compact coated alu" Option B "Compact, stainless"	95	122	185	248	302	302	302
	122	–	185	248	302	302	302
	140	–	–	248	302	302	302
Option C "Ultra-compact, stainless"	95	122	185	248	302	302	302
	113	–	185	248	302	302	302
	122	–	–	248	302	302	302

Ex nA, $_{C}CSA_{US}$ NI

SI units

Order Code for "Housing"	T_a [°C]	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
Option A "Compact coated alu" Option B "Compact, stainless"	35	50	85	120	150	150	150
	50	–	85	120	150	150	150
	60	–	–	120	150	150	150
Option C "Ultra-compact, stainless"	50	–	85	120	150	150	150
	60	–	–	120	150	150	150

US units

Order Code for "Housing"	T_a [°F]	T6 [185 °F]	T5 [212 °F]	T4 [275 °F]	T3 [392 °F]	T2 [572 °F]	T1 [842 °F]
Option A "Compact coated alu" Option B "Compact, stainless"	95	122	185	248	302	302	302
	122	–	185	248	302	302	302
	140	–	–	248	302	302	302
Option C "Ultra-compact, stainless"	122	–	185	248	302	302	302
	140	–	–	248	302	302	302


Explosion hazards arising from gas and dust

Determining the temperature class and surface temperature with the temperature table

- In the case of gas: Determine the temperature class as a function of the ambient temperature T_a and the medium temperature T_m.
- In the case of dust: Determine the maximum surface temperature as a function of the maximum ambient temperature T_a and the maximum medium temperature T_m.

Example

- Measured maximum ambient temperature: T_{ma} = 47 °C
- Measured maximum medium temperature: T_{mm} = 108 °C

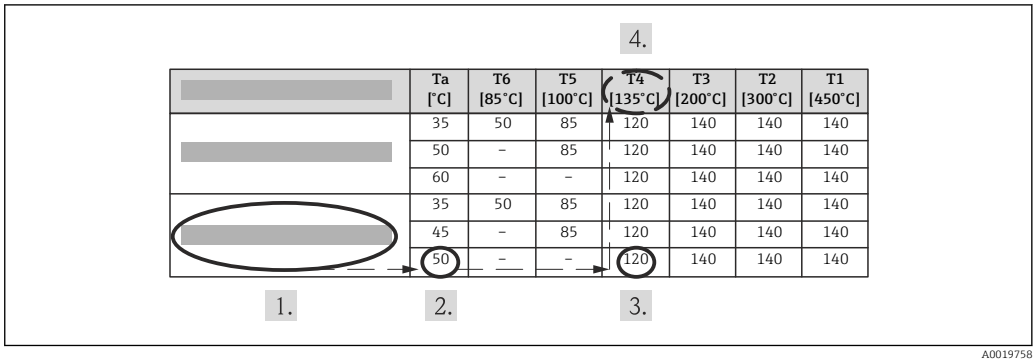

19 Procedure for determining the maximum surface temperature

1. Select device (optional).
2. In the column for the maximum ambient temperature T_a select the temperature that is immediately greater than or equal to the measured maximum ambient temperature T_{ma} that is present.
   ↳ T_a = 50 °C.

   The row showing the maximum medium temperature is determined.
3. Select the maximum medium temperature T_m of this row, which is larger or equal to the measured maximum medium temperature T_{mm}.
   ↳ The column with the temperature class for gas is determined: 108 °C ≤ 120°C → T4.
4. The maximum temperature of the temperature class determined corresponds to the maximum surface temperature for dust: T4 = 135 °C

Storage temperature

- −40 to +80 °C (−40 to +176 °F), preferably at +20 °C (+68 °F) (standard version)
- −50 to +80 °C (−58 to +176 °F) (Order code for *"Test, certificate"*, option JM)

Climate class

DIN EN 60068-2-38 (test Z/AD)

Degree of protection

Transmitter and sensor

- As standard: IP66/67, type 4X enclosure
- When housing is open: IP20, type 1 enclosure
- Display module: IP20, type 1 enclosure

Safety Barrier Promass 100
IP20

Shock resistance

As per IEC/EN 60068-2-31

Vibration resistance

Acceleration up to 1 g, 10 to 150 Hz, based on IEC/EN 60068-2-6

Electromagnetic compatibility (EMC)

- As per IEC/EN 61326 and NAMUR Recommendation 21 (NE 21)
- Complies with emission limits for industry as per EN 55011 (Class A)
- Device version with PROFIBUS DP: Complies with emission limits for industry as per EN 50170 Volume 2, IEC 61784

The following applies for PROFIBUS DP: If baud rates > 1.5 MBaud an EMC cable entry must be used and the cable shield must continue as far as the terminal wherever possible.

For details refer to the Declaration of Conformity.

Process

Medium temperature range

Sensor
−50 to +150 °C (−58 to +302 °F)

Seals
No internal seals


Density

0 to 5 000 kg/m³ (0 to 312 lb/cf)

Pressure-temperature ratings

The following pressure-temperature ratings refer to the entire device and not just the process connection.

Process connection: cylindrical internal thread BSP (G) according to ISO 228-1

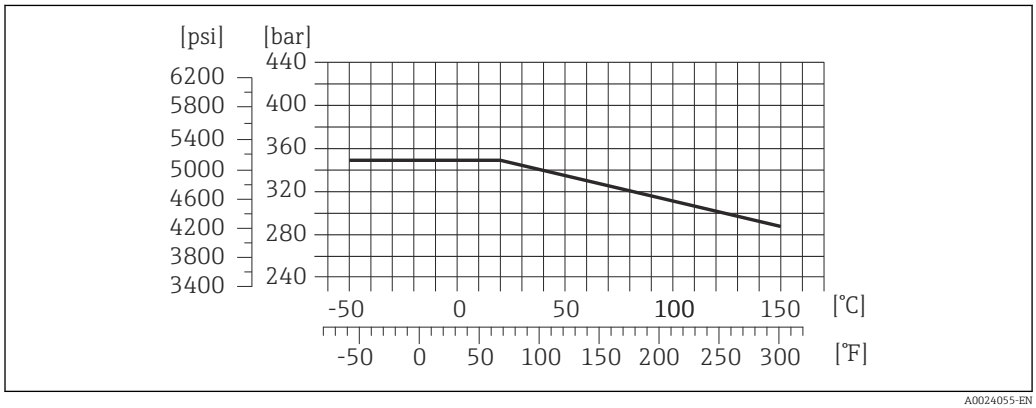

20 Process connection material: 1.4404 (316/316L)

Rupture disk

Trigger pressure in housing: 10 to 15 bar (145 to 218 psi)

Special mounting instructions: (→ 35)

Flow limit

Select the nominal diameter by optimizing between the required flow range and permissible pressure loss.

For an overview of the measuring range full scale values, see the "Measuring range" section (→ 6)

- The minimum recommended full scale value is approx. 1/20 of the maximum full scale value
- In most applications, 20 to 50 % of the maximum full scale value can be considered ideal
- A low full scale value must be selected for abrasive media (such as liquids with entrained solids): flow velocity < 1 m/s (< 3 ft/s).
- For gas measurement the following rules apply:
  - The flow velocity in the measuring tubes should not exceed half the sonic velocity (0.5 Mach).
  - The maximum mass flow depends on the density of the gas: formula (→ 🖹 6)


Pressure loss

To calculate the pressure loss, use the *Applicator* sizing tool (→ 🖹 52)

System pressure

It is important that cavitation does not occur, or that gases entrained in the liquids do not outgas. This is prevented by means of a sufficiently high system pressure.


For this reason, the following mounting locations are recommended:
- At the lowest point in a vertical pipe
- Downstream from pumps (no danger of vacuum)

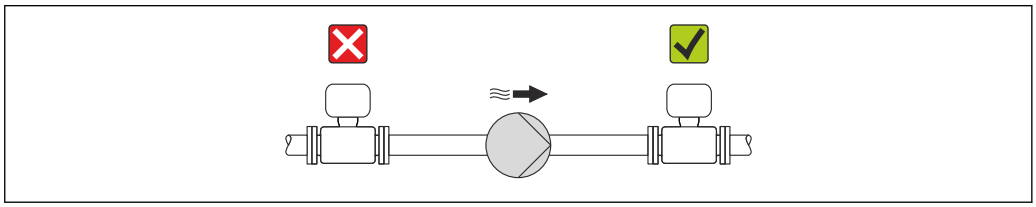

A0015594

Thermal insulation

In the case of some fluids, it is important that the heat radiated from the sensor to the transmitter is kept to a minimum. A wide range of materials can be used for the required insulation.

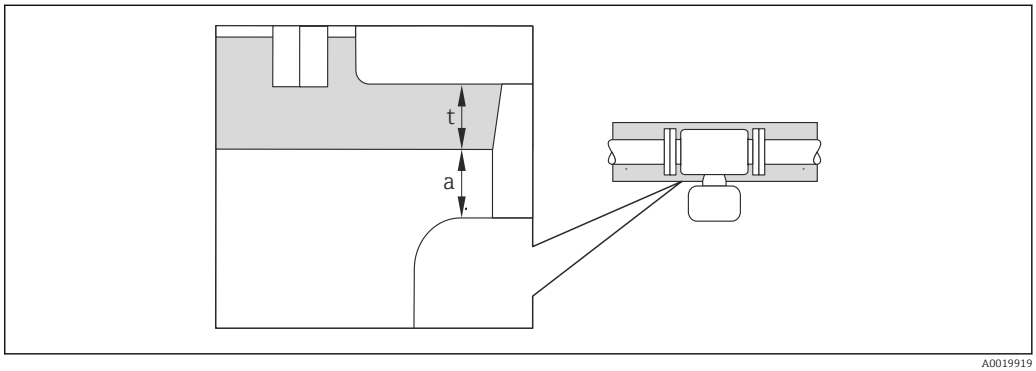

A0019919

a *Minimum distance to insulation*
t *maximum Insulation thickness*

The minimum distance between the transmitter housing and the insulation is 10 mm (0.39 in) so that the transmitter head remains completely exposed.

NOTICE

Danger of overheating with insulation

▶ Ensure that the temperature at the lower end of the transmitter housing does not exceed 80 °C (176 °F)

NOTICE

The insulation can also be thicker than the maximum recommended insulation thickness.

Prerequisite:

▶ Ensure that convection takes place on a sufficiently large scale at the transmitter neck.
▶ Ensure that a sufficiently large area of the housing support remains exposed. The uncovered part serves as a radiator and protects the electronics from overheating and excessive cooling.

Vibrations


The high oscillation frequency of the measuring tubes ensures that the correct operation of the measuring system is not influenced by plant vibrations.

Mechanical construction

Design, dimensions

Compact version

Order code for "Housing", option A "Alu"

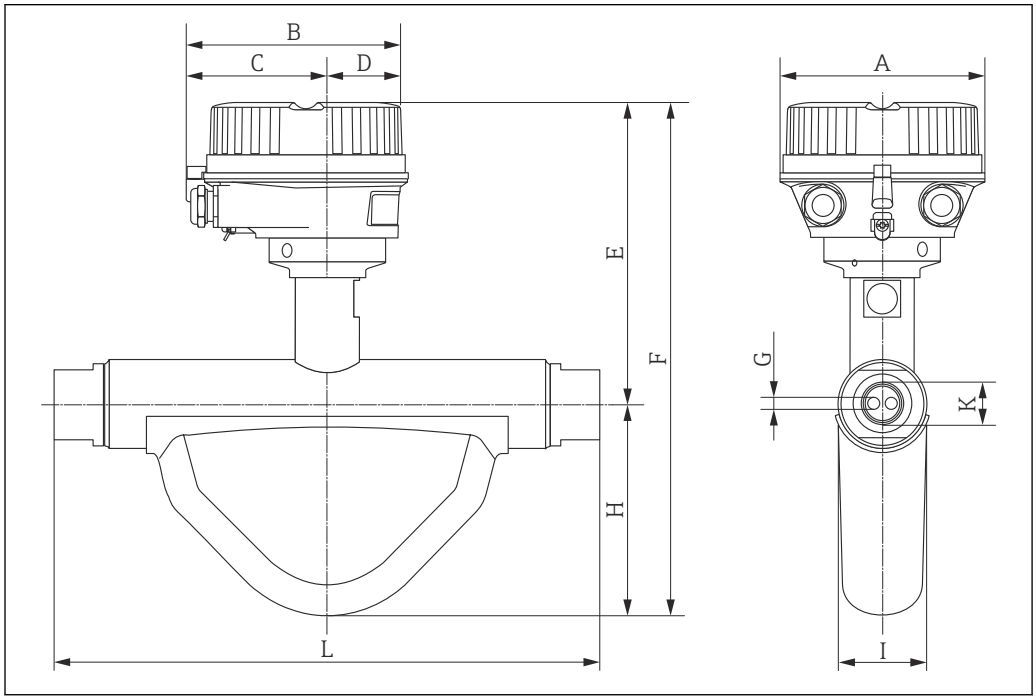

A0022580

Dimensions SI units

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [1] [mm]	F [1] [mm]	G [mm]	H [mm]	I [mm]	K [in]	L [mm]
8	136	147.5	93.5	54	177	266	3.87	89	40	G½	214
15	136	147.5	93.5	54	177	277	6.23	100	38	G¾	267
25	136	147.5	93.5	54	174	276	8.80	102	48	G1	316


1) If using a display, order code for "Display; Operation", option B: values +28 mm

Dimensions US units

DN [in]	A [in]	B [in]	C [in]	D [in]	E [1] [in]	F [1]" [in]	G [in]	H [in]	I [in]	K [in]	L [in]
⅜	5.35	5.81	3.68	2.13	6.97	10.47	0.15	3.50	1.57	G½	8.43
½	5.35	5.81	3.68	2.13	6.97	10.91	0.25	3.94	1.50	G¾	10.5
1	5.35	5.81	3.68	2.13	6.85	10.87	0.35	4.02	1.89	G1	12.4

1) If using a display, Order Code for "Display; Operation", Option B "Values +1.1 in

Order code for "Housing", option B "Compact, stainless"

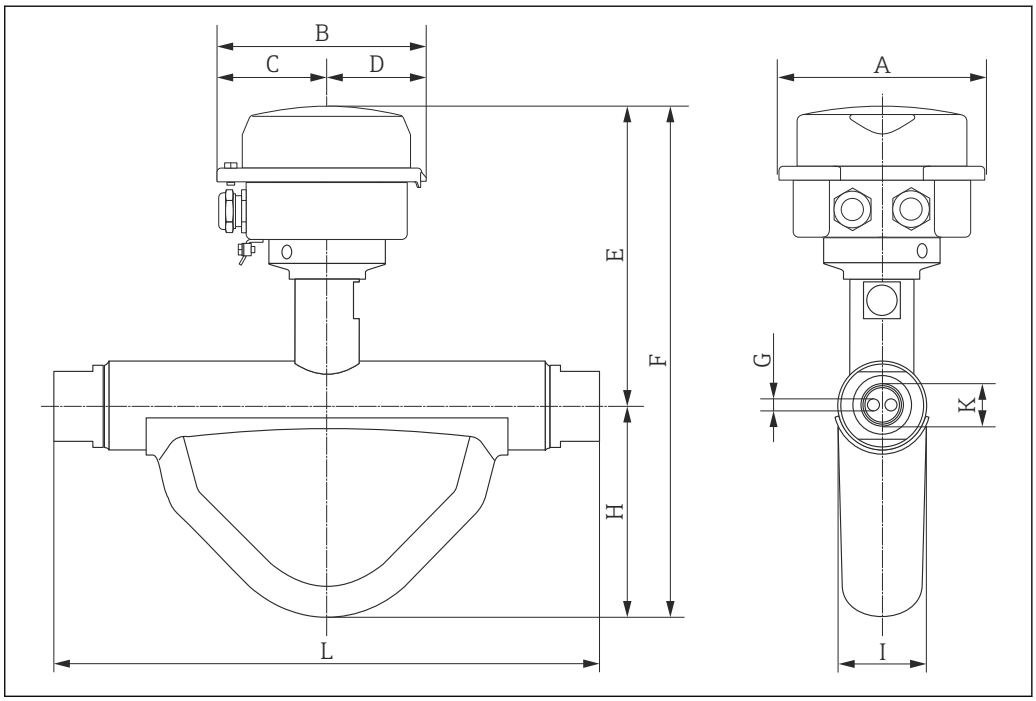

A0024051

Dimensions SI units

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [1] [mm]	F [1] [mm]	G [mm]	H [mm]	I [mm]	K [in]	L [mm]
8	133.5	136.8	78	58.8	172	261	3.87	89	40	G½	214
15	133.5	136.8	78	58.8	172	272	6.23	100	38	G¾	267
25	133.5	136.8	78	58.8	169	271	8.80	102	48	G1	316


1) If using a display, order code for "Display; Operation", option B: values +14 mm

Dimensions US units

DN [in]	A [in]	B [in]	C [in]	D [in]	E [1] [in]	F [1] [in]	G [in]	H [in]	I [in]	K [in]	L [in]
⅜	5.26	5.39	3.07	2.31	6.77	10.28	0.15	3.50	1.57	G½	8.43
½	5.26	5.39	3.07	2.31	6.77	10.71	0.25	3.94	1.50	G¾	10.5
1	5.26	5.39	3.07	2.31	6.65	10.67	0.35	4.02	1.89	G1	12.4

1) If using a display, order code for "Display; Operation", option B: values +0.55 in

Order Code for "Housing", Option C "Ultra-compact, stainless"

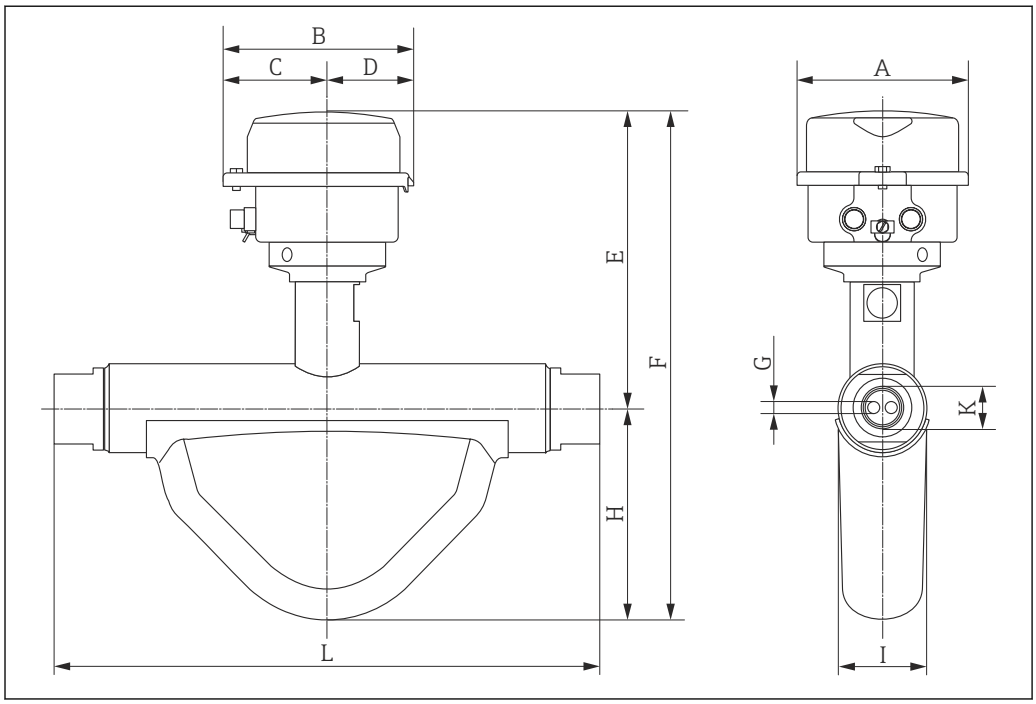

A0024052

Dimensions SI units

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [1] [mm]	F [1] [mm]	G [mm]	H [mm]	I [mm]	K [in]	L [mm]
8	111.4	123.6	67.7	55.9	172	261	3.87	89	40	G½	214
15	111.4	123.6	67.7	55.9	172	272	6.23	100	38	G¾	267
25	111.4	123.6	67.7	55.9	169	271	8.80	102	48	G1	316

1) If using a display, order code for "Display; Operation", option B: values +14 mm


Dimensions US units

DN [in]	A [in]	B [in]	C [in]	D [in]	E [1] [in]	F [1] [in]	G [in]	H [in]	I [in]	K [in]	L [in]
⅜	4.39	4.87	2.67	2.2	6.77	10.28	0.15	3.50	1.57	G½	8.43
½	4.39	4.87	2.67	2.2	6.77	10.71	0.25	3.94	1.50	G¾	10.5
1	4.39	4.87	2.67	2.2	6.65	10.67	0.35	4.02	1.89	G1	12.4

1) If using a display, order code for "Display; Operation", option B: values +0.55 in

Safety Barrier Promass 100

Top-hat rail EN 60715:
- TH 35 x 7.5
- TH 35 x 15

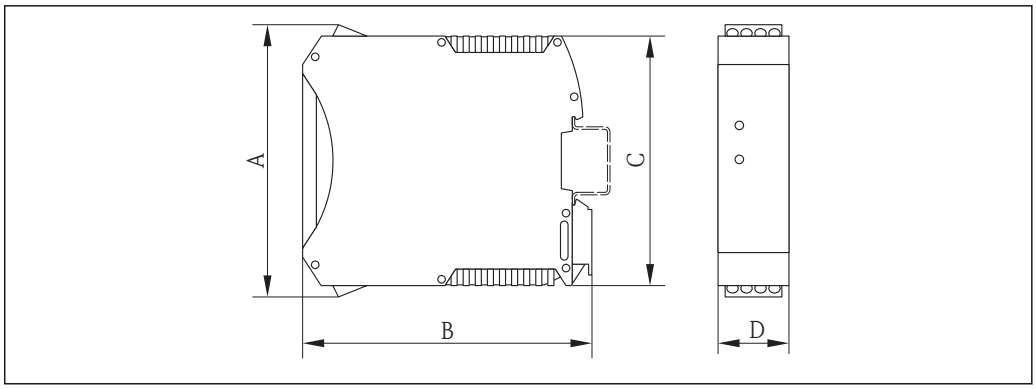

A0016777

A		B		C		D	
[mm]	[in]	[mm]	[in]	[mm]	[in]	[mm]	[in]
108	4.25	114.5	4.51	99	3.9	22.5	0.89

Weight

Compact version

Weight in SI units

DN [mm]	Weight [kg]
8	3.8
15	4.4
25	5.1

Weight in US units

DN [in]	Weight [lbs]
⅜	8.4
½	9.7
1	11.3

Safety Barrier Promass 100


49 g (1.73 ounce)

Materials

Transmitter housing

- Order code for "Housing", option **A** "Compact, aluminum coated":
  Aluminum, AlSi10Mg, coated
- Order code for "Housing", option **B** "Compact, stainless":
  Stainless steel 1.4301 (304)
- Order code for "Housing", option **C** "Ultra-compact, stainless":
  Stainless steel 1.4301 (304)

Cable entries/cable glands

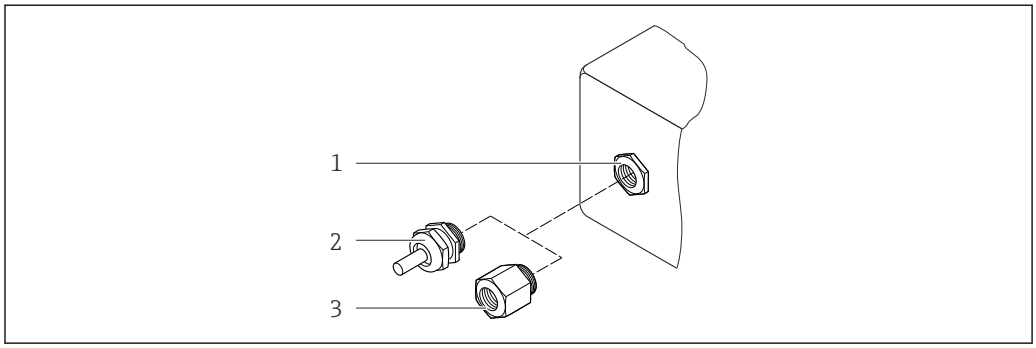

21 *Possible cable entries/cable glands*

1 *Cable entry in transmitter housing, wall-mount housing or connection housing with internal thread M20 x 1.5*
2 *Cable gland M20 x 1.5*
3 *Adapter for cable entry with internal thread G ½" or NPT ½"*

Order Code for "Housing", Option A "Compact, coated aluminum"

The various cable entries are suitable for hazardous and non-hazardous areas.

Cable entry/cable gland	Material
Cable gland M20 × 1.5	Nickel-plated brass
Adapter for cable entry with internal thread G ½"	
Adapter for cable entry with internal thread NPT ½"	

Order code for "Housing", option B "Compact, stainless"

The various cable entries are suitable for hazardous and non-hazardous areas.

Cable entry/cable gland	Material
Cable gland M20 × 1.5	Stainless steel, 1.4404 (316L)
Adapter for cable entry with internal thread G ½"	
Adapter for cable entry with internal thread NPT ½"	

Device plug

Electrical connection	Material
Plug M12x1	▪ Socket: Stainless steel, 1.4404 (316L) ▪ Contact housing: Polyamide ▪ Contacts: Gold-plated brass

Sensor housing

- Acid and alkali-resistant outer surface
- Stainless steel 1.4301 (304)

Measuring tubes

Stainless steel, 1.4435 (316L)

Process connections/manifolds

For all process connections/manifolds
Stainless steel, 1.4404 (316/316L)

List of all available process connections (→ 🖹 45)

Surface quality (parts in contact with medium)

All data relate to parts in contact with fluid.
Not polished

Seals

Welded process connections without internal seals

Safety Barrier Promass 100

Housing: Polyamide

Process connections

Internal thread
Cylindrical internal thread BSPP (G) in accordance with ISO 228-1 with sealing surfaces in accordance with DIN 3852-2/ISO 1179-1

Sealed with profile seal (not included in scope of delivery) in accordance with DIN 3869 or copper disk or steel gasket with plastic lip.

For information on the materials of the process connections (→ 🖹 44)

Operability

Operating concept

Operator-oriented menu structure for user-specific tasks
- Commissioning
- Operation
- Diagnostics
- Expert level

Quick and safe commissioning
- Individual menus for applications
- Menu guidance with brief explanations of the individual parameter functions

Reliable operation
- Operation in the following languages:
  - Via "FieldCare" operating tool:
    English, German, French, Spanish, Italian, Chinese, Japanese
  - Via Web browser:
    English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Bahasa (Indonesian), Vietnamese, Czech
- Uniform operating philosophy applied to operating tools and Web browser
- If replacing the electronic module, transfer the device configuration via the plug-in memory (HistoROM DAT) which contains the process and measuring device data and the event logbook. No need to reconfigure.
  For devices with Modbus RS485, the data recovery function is implemented without the plug-in memory (HistoROM DAT).

Efficient diagnostics increase measurement availability
- Troubleshooting measures can be called up via the operating tools and Web browser
- Diverse simulation options
- Status indicated by several light emitting diodes (LEDs) on the electronic module in the housing compartment

Local display


The local display is only available with the following device version:
Order code for "Display; Operation", option **B**: 4-line; lit, via communication

Display element
- 4-line liquid crystal display with 16 characters per line.
- White background lighting; switches to red in event of device errors.
- Format for displaying measured variables and status variables can be individually configured.
- Permitted ambient temperature for the display: –20 to +60 °C (–4 to +140 °F). The readability of the display may be impaired at temperatures outside the temperature range.

Remote operation

Via HART protocol

This communication interface is present in the following device version:
Order code for "Output", option **B**: 4-20 mA HART, pulse/frequency/switch output

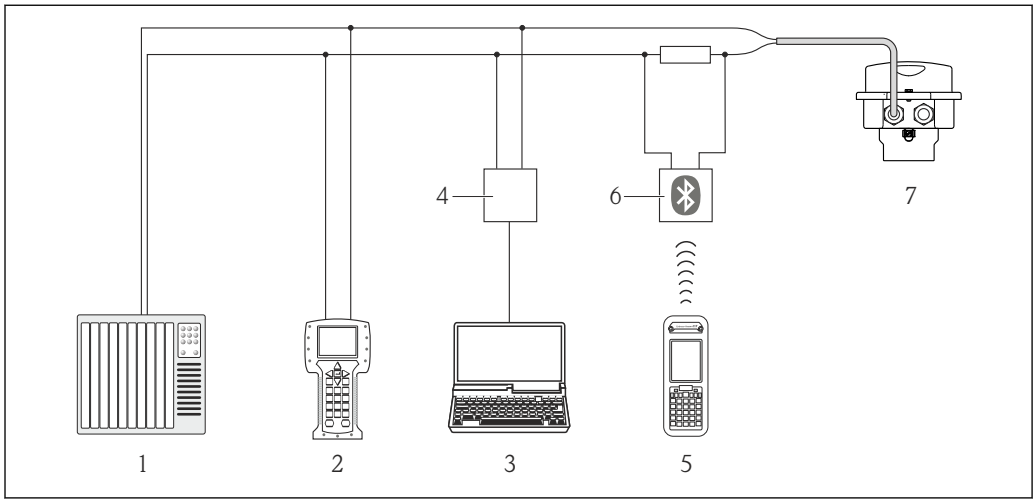


22 Options for remote operation via HART protocol

1 *Control system (e.g. PLC)*
2 *Field Communicator 475*
3 *Computer with operating tool (e.g. FieldCare, AMS Device Manager, SIMATIC PDM)*
4 *Commubox FXA195 (USB)*
5 *Field Xpert SFX350 or SFX370*
6 *VIATOR Bluetooth modem with connecting cable*
7 *Transmitter*

Via PROFIBUS DP network


This communication interface is present in the following device version:
Order code for "Output", option **L**: PROFIBUS DP

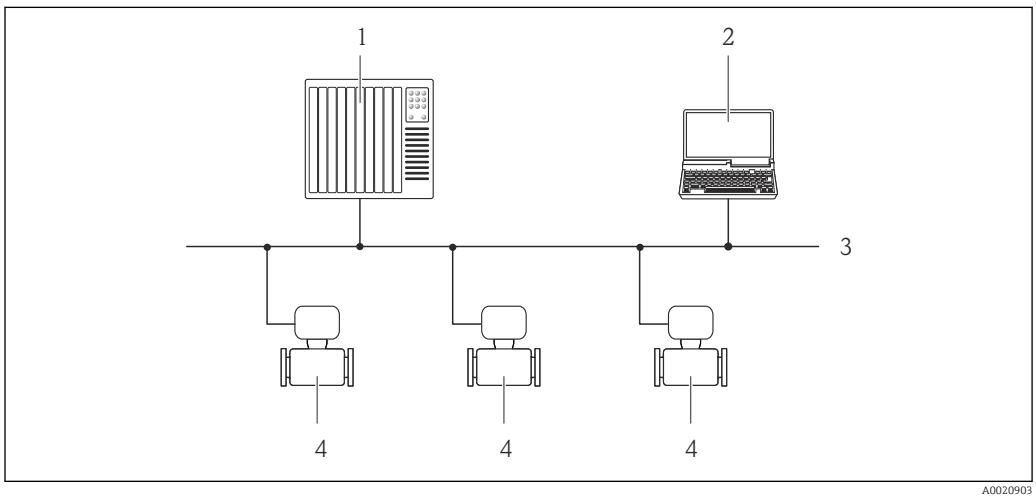

1 *Automation system*
2 *Computer with PROFIBUS network card*
3 *PROFIBUS DP network*
4 *Measuring device*

Via Ethernet-based fieldbus

This communication interface is present in the following device version:
Order code for "Output", option **N**: EtherNet/IP

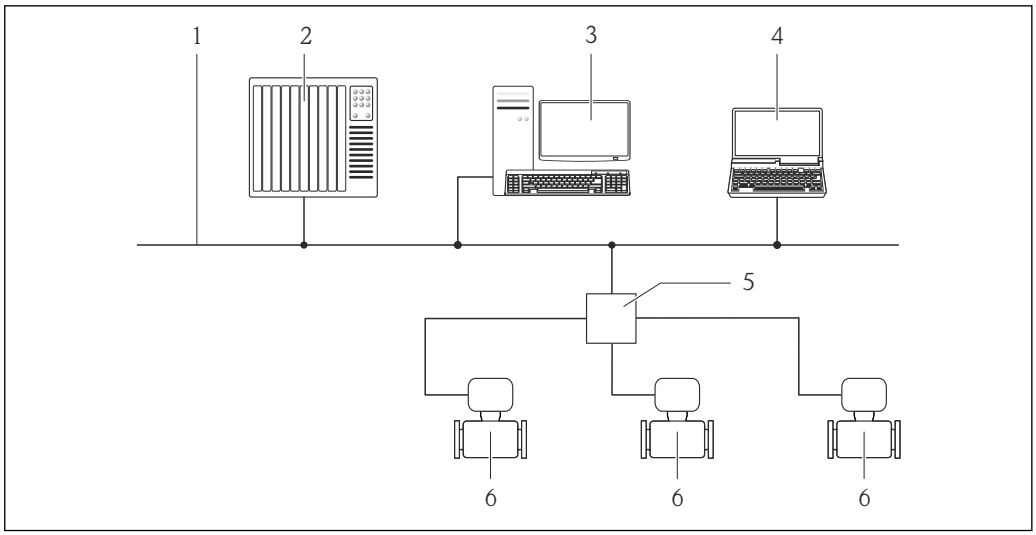

A0016961


1 Ethernet network
2 Automation system, e.g. "RSLogix" (Rockwell Automation)
3 Workstation for measuring device operation: with Add-on Profile Level 3 for "RSLogix 5000" (Rockwell Automation) or with Electronic Data Sheet (EDS)
4 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with "FieldCare" operating tool with COM DTM "CDI Communication TCP/IP"
5 Ethernet switch
6 Measuring device

Service interface

Service interface (CDI-RJ45)

This communication interface is present in the following device version:
- Order code for "Output", option **B**: 4-20 mA HART, pulse/frequency/switch output
- Order code for "Output", option **L**: PROFIBUS DP
- Order code for "Output", option **N**: EtherNet/IP

HART

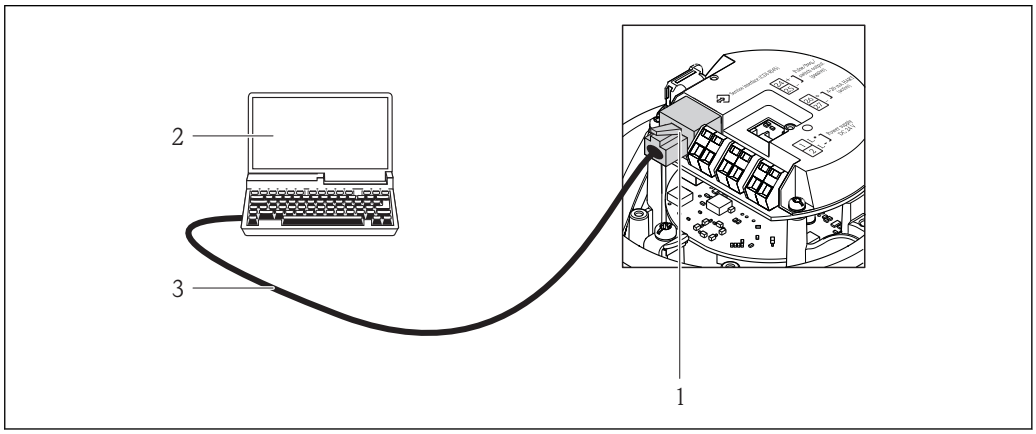


A0016926

23 Connection for the order code for "Output", option B: 4-20 mA HART, pulse/frequency/switch output

1 Service interface (CDI -RJ45) of the measuring device with access to the integrated Web server
2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with "FieldCare" operating tool with COM DTM "CDI Communication TCP/IP"
3 Standard Ethernet connecting cable with RJ45 plug


PROFIBUS DP

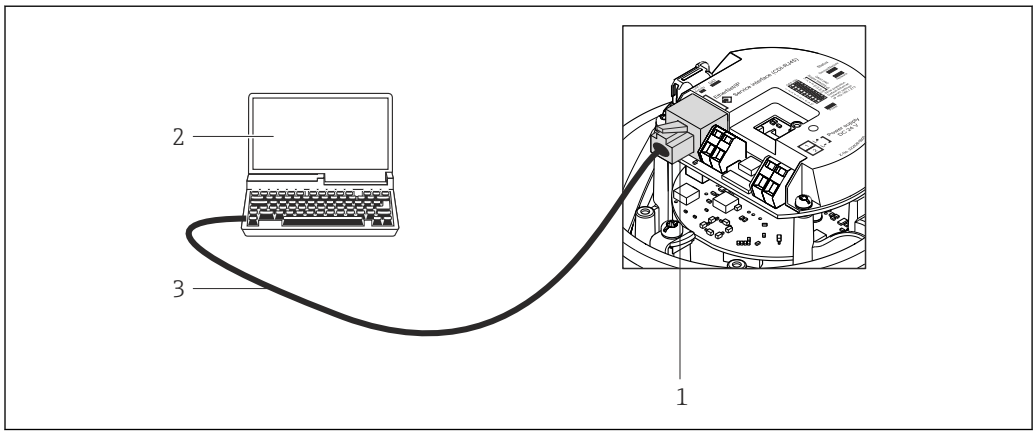

24 Connection for order code for "Output", option L: PROFIBUS DP

1 Service interface (CDI -RJ45) of the measuring device with access to the integrated Web server
2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with "FieldCare" operating tool with COM DTM "CDI Communication TCP/IP"
3 Standard Ethernet connecting cable with RJ45 plug

EtherNet/IP

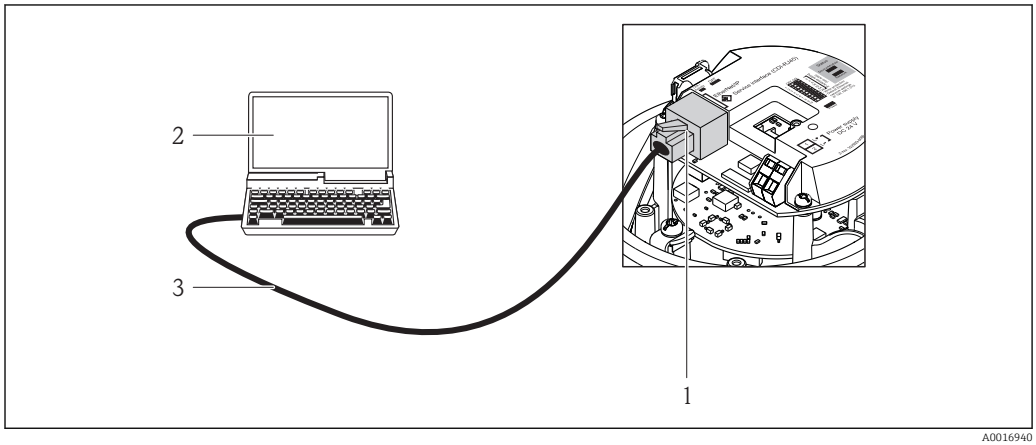


25 Connection for order code for "Output", option N: EtherNet/IP

1 Service interface (CDI -RJ45) and EtherNet/IP interface of the measuring device with access to the integrated Web server
2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with "FieldCare" operating tool with COM DTM "CDI Communication TCP/IP"
3 Standard Ethernet connecting cable with RJ45 plug

Service interface (CDI)

This communication interface is present in the following device version:
Order code for "Output", option **M**: Modbus RS485

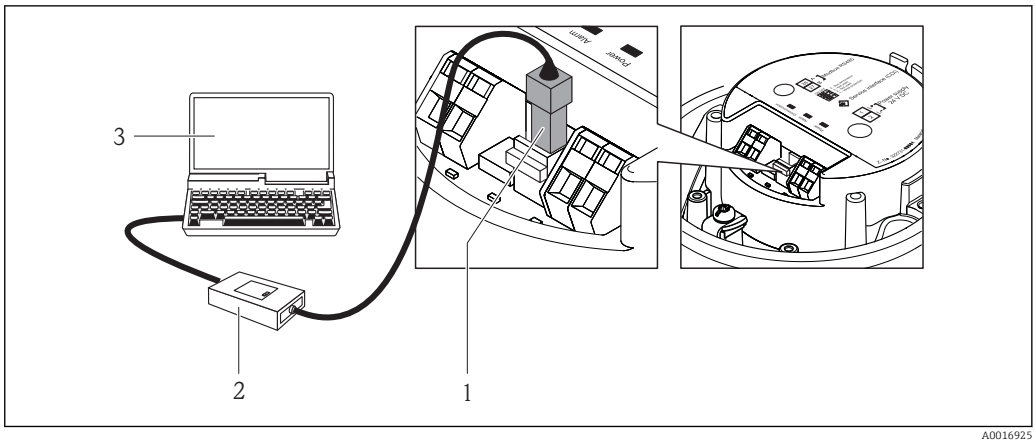

1 Service interface (CDI) of the measuring device
2 Commubox FXA291
3 Computer with "FieldCare" operating tool with COM DTM "CDI Communication FXA291"

Certificates and approvals

CE mark

The measuring system is in conformity with the statutory requirements of the applicable EC Directives. These are listed in the corresponding EC Declaration of Conformity along with the standards applied.

Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.

C-Tick symbol

The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".

Ex approval

The measuring device is certified for use in hazardous areas and the relevant safety instructions are provided in the separate "Safety Instructions" (XA) document. Reference is made to this document on the nameplate.

The separate Ex documentation (XA) containing all the relevant explosion protection data is available from your Endress+Hauser sales center.

ATEX/IECEx

Currently, the following versions for use in hazardous areas are available:

Ex ia

Category (ATEX)	Type of protection
II2G	Ex ia IIC T6...T1 Gb
II2G	Ex ia IIC T6...T1 Gb
II1/2G, II2D	Ex ia IIC T6...T1 Ga/Gb Ex tb IIIC Txx °C Db
II2G, II2D	Ex ia IIC T6...T1 Gb Ex tb IIIC Txx °C Db

Ex nA

Category (ATEX)	Type of protection
II3G	Ex nA IIC T6...T1 Gc or Ex nA IIC T5-T1 Gc

$_{c}$CSA$_{US}$

Currently, the following versions for use in hazardous areas are available:

IS (Ex i)
- Class I Division 1 Groups ABCD
- Class II Division 1 Groups EFG and Class III

NI (Ex nA)
Class I Division 2 Groups ABCD

Certification PROFIBUS

PROFIBUS interface

The measuring device is certified and registered by the PROFIBUS User Organization (PNO). The measuring system meets all the requirements of the following specifications:
- Certified in accordance with PROFIBUS PA Profile 3.02
- The device can also be operated with certified devices of other manufacturers (interoperability)

Modbus RS485 certification

The measuring device meets all the requirements of the MODBUS/TCP conformity test and has the "MODBUS/TCP Conformance Test Policy, Version 2.0". The measuring device has successfully passed all the test procedures carried out and is certified by the “MODBUS/TCP Conformance Test Laboratory” of the University of Michigan.

EtherNet/IP certification

The measuring device is certified and registered by the ODVA (Open Device Vendor Association). The measuring system meets all the requirements of the following specifications:
- Certified in accordance with the ODVA Conformance Test
- EtherNet/IP Performance Test
- EtherNet/IP PlugFest compliance
- The device can also be operated with certified devices of other manufacturers (interoperability)

Other standards and guidelines

- EN 60529
  Degrees of protection provided by enclosures (IP code)
- IEC/EN 60068-2-6
  Environmental influences: Test procedure - Test Fc: vibrate (sinusoidal).
- IEC/EN 60068-2-31
  Environmental influences: Test procedure - Test Ec: shocks due to rough handling, primarily for devices.
- EN 61010-1
  Safety requirements for electrical equipment for measurement, control and laboratory use
- IEC/EN 61326
  Emission in accordance with Class A requirements. Electromagnetic compatibility (EMC requirements).
- NAMUR NE 21
  Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment
- NAMUR NE 32
  Data retention in the event of a power failure in field and control instruments with microprocessors
- NAMUR NE 43
  Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 53
  Software of field devices and signal-processing devices with digital electronics
- NAMUR NE 105
  Specifications for integrating fieldbus devices in engineering tools for field devices
- NAMUR NE 107
  Self-monitoring and diagnosis of field devices
- NAMUR NE 131
  Requirements for field devices for standard applications
- NAMUR NE 132
  Coriolis mass meter

Ordering information

Detailed ordering information is available from the following sources:
- In the Product Configurator on the Endress+Hauser web site: www.endress.com → Choose your country → Products → Select measuring technology, software or components → Select product (picklists: measurement method, product family etc.) → Device support (right-hand column): Configure the selected product → The Product Configurator for the selected product is opened.
- From your Endress+Hauser Sales Center: www.addresses.endress.com

Product Configurator - the tool for individual product configuration
- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Application packages

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered from Endress+Hauser either directly with the device or subsequently. Detailed information on the order code in question is available from your local Endress +Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

Detailed information on the application packages:
Special Documentation on the device

Heartbeat Technology

Package	Description
Heartbeat Verification +Monitoring	**Heartbeat Monitoring:** Continuously supplies monitoring data, which are characteristic of the measuring principle, for an external condition monitoring system. This makes it possible to: ▪ Draw conclusions - using these data and other information - about the impact the measuring application has on the measuring performance over time. ▪ Schedule servicing in time. ▪ Monitor the product quality, e.g. gas pockets. **Heartbeat Verification:** Makes it possible to check the device functionality on demand when the device is installed, without having to interrupt the process. ▪ Access via onsite operation or other operating interfaces, such as FieldCare for instance. ▪ Documentation of device functionality within the framework of manufacturer specifications, for proof testing for instance. ▪ End-to-end, traceable documentation of the verification results, including report. ▪ Makes it possible to extend calibration intervals in accordance with operator's risk assessment.

Concentration

Package	Description
Concentration Measurement	**Calculation and outputting of fluid concentrations** Many applications use density as a key measured value for monitoring quality or controlling processes. The device measures the density of the fluid as standard and makes this value available to the control system. With the help of the "Concentration Measurement" application package, the measured density is used to calculate other process parameters: ▪ Temperature-compensated density (reference density). ▪ Percentage mass of the individual substances in a two-phase fluid. (Concentration in %). ▪ Fluid concentration is output with special units (°Brix, °Baumé, °API, etc.) for standard applications. The measured values are output via the digital and analog outputs of the device.

Accessories

Various accessories, which can be ordered with the device or subsequently from Endress+Hauser, are available for the device. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

Communication-specific accessories

Accessories	Description
Commubox FXA195 HART	For intrinsically safe HART communication with FieldCare via the USB interface. For details, see "Technical Information" TI00404F
HART Loop Converter HMX50	Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values. For details, see "Technical Information" TI00429F and Operating Instructions BA00371F
Wireless HART adapter SWA70	Is used for the wireless connection of field devices. The WirelessHART adapter can be easily integrated into field devices and existing infrastructures, offers data protection and transmission safety and can be operated in parallel with other wireless networks with minimum cabling complexity. For details, see Operating Instructions BA00061S
Fieldgate FXA320	Gateway for the remote monitoring of connected 4-20 mA measuring devices via a Web browser. For details, see "Technical Information" TI00025S and Operating Instructions BA00053S
Fieldgate FXA520	Gateway for the remote diagnostics and remote configuration of connected HART measuring devices via a Web browser. For details, see "Technical Information" TI00025S and Operating Instructions BA00051S
Field Xpert SFX350	Field Xpert SFX350 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the **non-Ex area**. For details, see Operating Instructions BA01202S
Field Xpert SFX370	Field Xpert SFX370 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the **non-Ex area** and the **Ex area**. For details, see Operating Instructions BA01202S

Service-specific accessories

Accessories	Description
Applicator	Software for selecting and sizing Endress+Hauser measuring devices: ▪ Calculation of all the necessary data for identifying the optimum flowmeter: e.g. nominal diameter, pressure loss, accuracy or process connections. ▪ Graphic illustration of the calculation results Administration, documentation and access to all project-related data and parameters throughout the entire life cycle of a project. Applicator is available: ▪ Via the Internet: https://wapps.endress.com/applicator ▪ On CD-ROM for local PC installation.

W@M	Life cycle management for your plant W@M supports you with a wide range of software applications over the entire process: from planning and procurement, to the installation, commissioning and operation of the measuring devices. All the relevant device information, such as the device status, spare parts and device-specific documentation, is available for every device over the entire life cycle. The application already contains the data of your Endress+Hauser device. Endress +Hauser also takes care of maintaining and updating the data records. W@M is available: ▪ Via the Internet: www.endress.com/lifecyclemanagement ▪ On CD-ROM for local PC installation.
FieldCare	FDT-based plant asset management tool from Endress+Hauser. It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition. For details, see Operating Instructions BA00027S and BA00059S
Commubox FXA291	Connects Endress+Hauser field devices with a CDI interface (= Endress+Hauser Common Data Interface) and the USB port of a computer or laptop. For details, see "Technical Information" TI00405C

Documentation

For an overview of the scope of the associated Technical Documentation, refer to the following:
- The CD-ROM provided for the device (depending on the device version, the CD-ROM might not be part of the delivery!)
- The *W@M Device Viewer* : Enter the serial number from the nameplate (www.endress.com/deviceviewer)
- The *Endress+Hauser Operations App*: Enter the serial number from the nameplate or scan the 2-D matrix code (QR code) on the nameplate.

Standard documentation

Brief Operating Instructions

Measuring device	Documentation code
Promass G 100	KA01180D

Operating Instructions

	Documentation code			
Measuring device	HART	PROFIBUS DP	Modbus RS485	EtherNet/IP
Promass G 100	BA01346D	BA01348D	BA01345D	BA01347D

Supplementary device-dependent documentation

Safety Instructions

Contents	Documentation code
ATEX/IECEx Ex i	XA00159D
ATEX/IECEx Ex nA	XA01029D
cCSAus IS	XA00160D
INMETRO Ex i	XA01219D
INMETRO Ex nA	XA01220D

Special Documentation

Contents	Documentation code
Modbus RS485 Register Information	SD00154D
Concentration Measurement	SD01152D
Heartbeat Technology	SD01153D

Installation instructions

Contents	Documentation code
Installation Instructions for spare part sets	Specified for each individual accessory (→ 🖹 52)

Registered trademarks

HART®
Registered trademark of the HART Communication Foundation, Austin, USA

PROFIBUS®
Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

Modbus®
Registered trademark of SCHNEIDER AUTOMATION, INC.

EtherNet/IP™
Trademark of ODVA, Inc.

Microsoft®
Registered trademark of the Microsoft Corporation, Redmond, Washington, USA

Applicator®, FieldCare®, Field Xpert™, HistoROM®, Heartbeat Technology™
Registered or registration-pending trademarks of the Endress+Hauser Group

www.addresses.endress.com

Endress+Hauser

People for Process Automation