

ROTADISK Pneumatic Actuator

Type RD & RDF 2,5 – 160

AIOM001063

Translation of the original instructions

**Installation
Operation
Maintenance**



These instructions must be read and observed before using an ROTADISK Pneumatic Actuators.





Copyright Notice

All rights reserved. No part of these instructions may be reproduced, stored in a retrieval system or transmitted in any form or by any means without the prior consent of Flowserve Corporation.

Document Version

Rev.: 00, 05. May 2026

Table of Contents

1	General Information.....	4
1.1	Scope of Manual	4
1.2	Disclaimer	4
1.3	Certification Instruction	5
1.4	Units	5
2	Technical Data	6
2.1	Overview of ROTADISK Pneumatic Actuator versions	6
2.2	Nameplate: Identification of the ROTADISK Pneumatic Actuator	11
3	Safety Information	12
3.1	Intended Use	12
3.2	Safety Symbols and Description	13
3.3	Application Limits.....	13
3.4	General Sources of Danger	14
3.5	Responsibility of the Operating Company	14
3.6	Qualified Personnel and Target Group	15
3.7	Personal Protective Equipment	16
3.8	General Sources of Hazard/Residual Hazards	17
4	Product Description.....	18
4.1	General Product Description	18
4.2	Variants.....	20
4.3	Functional Description.....	20
4.4	Scope of Delivery.....	21
5	Receipt of Goods	22
5.1	Safety Information	22
5.2	Examining Received Goods	22
5.3	Unpacking the ROTADISK Pneumatic Actuator	22
6	Installation.....	23
6.1	Safety Information	23
6.2	Preparations for ROTADISK Pneumatic Actuator Installation	23
6.3	Installing ROTADISK Pneumatic Actuator on the Valve	24

7	Commissioning	25
7.1	Safety Information	25
7.2	Commissioning the ROTADISK Pneumatic Actuator	26
8	Maintenance	27
8.1	Safety Information	27
8.2	Required Spare Parts for Maintenance	27
8.3	Maintenance Plan	27
9	Repair	28
9.1	Safety Information	28
9.2	Required Spare Parts	28
9.3	Required Spare Parts	29
9.4	Repairing the ROTADISK Pneumatic Actuator	29
9.5	Troubleshooting Table	42
9.6	Sending In the ROTADISK Pneumatic Actuator for Repair	43
10	Shutdown	44
10.1	Safety Information	44
10.2	Shutting Down the ROTADISK Pneumatic Actuator	44
11	Storage	45
11.1	Safety Information	45
11.2	Storing the ROTADISK Pneumatic Actuator	45
12	Packing	46
12.1	Safety Information	46
12.2	Packing the ROTADISK Pneumatic Actuator	46
13	Transport.....	47
13.1	Safety Information	47
13.2	Transporting the ROTADISK Pneumatic Actuator	48
14	Disposal and Recycling	49
14.1	Safety Information	49
14.2	Disposing of and Recycling the ROTADISK Pneumatic Actuator	49

Appendix A: Manufacturer's Declaration	50
Appendix B: Declaration of Incorporation	51
Appendix C: Torques of the ROTADISK Pneumatic Actuators	52

1 General Information

1.1 Scope of Manual

These instructions are intended to familiarise the reader with the ROTADISK Pneumatic Actuator and its proper use. Use of the ROTADISK Pneumatic Actuator in compliance with these instructions is important to ensure its functionality and to avoid hazards.

These instructions contains information for qualified personnel for using the ROTADISK Pneumatic Actuator for its intended purpose.

Often, ARGUS ball valves are automated with a mounted pneumatic, hydraulic, or electric actuator with the corresponding control instrumentation for automated functioning and monitoring of the complete automated ball valve. For automated ball valves, these manual forms part of the comprehensive user documentation for the equipment. The instructions for all components must be observed.

	Read these instructions before using the ROTADISK Pneumatic Actuator in any region world-wide and pay particular attention to the safety-relevant warnings, information and notes.
	Do not put the ROTADISK Pneumatic Actuator into operation until all the safe conditions referred to in these instructions are satisfied.
	Failure to observe the information contained in these instructions will be considered as misuse of the product. Personal injury, product damages, holdups in operation or product failure due to misuse of the product are not covered by the Flowserve guarantee.
	Observe all the relevant local health and work safety regulations at the place of work – even when these are not explicitly referred to in these instructions.
	Coordinate all repair work with the operating personnel and observe all safety regulations of the industrial plant and applicable health and safety laws.
	Inform Flowserve Flow Control GmbH if documents are missing or incomplete. You will then receive replacements in electronic form.
	Provide these instructions at all workplaces near the production site.

1.2 Disclaimer

The information in these instructions can be considered as complete and reliable. Despite all efforts of Flowserve Flow Control GmbH to supply comprehensible information and instructions, good engineering and safety practice must be applied at all times. Please consult a qualified engineer if in doubt.

Flowserve Flow Control GmbH manufacturers products according to applicable international quality management standards which are audited by external quality assurance organisations. Original spare parts and original accessories have been designed, tested and incorporated into Flowserve products to ensure continuous product quality and product performance in use. Since Flowserve Flow Control GmbH cannot test the spare parts and accessories of other manufacturers, (incorrect) installation of these parts can have a detrimental effect on the performance and safety properties of the product. The wrong choice or incorrect installation or failure to use approved Flowserve spare parts and accessories will be considered as misuse of the product. Damage or failure due to product

misuse is not covered by the Flowserve guarantee. Moreover, any modifications to Flowserve products or the removal of original components can impair the safety of the products in use.

1.3 Certification Instruction

The design of ARGUS ball valves takes all relevant laws, directives, standards, and specifications into account, such as the European Directive for Pressure Equipment 2014/68/EU, EN 12516, AD 2000 Regulations, API 6D, API608 and ASME/ANSI B16.34 and others, depending on the specified application.

The careful selection, design and calculation of materials as well as quality assurance performed during materials procurement, in production and on finished products ensure the elimination of pressure-related hazards when the ARGUS ball valves are used as intended.

As a manufacturer, Flowserve Flow Control GmbH applies the conformity assessment procedure according to module H (Article 14 of European Pressure Equipment Directive 2014/68/EU), i.e., "Comprehensive Quality Assurance" as described in Appendix III, Paragraph 11.

ARGUS ball valves are marked according to the provisions of the European Pressure Equipment Directive with the CE mark as well as the identification number of the notified conformity assessment body if sold in the European Union or otherwise specified.

For the ARGUS ball valves, which are covered by the provisions of the European Pressure Equipment Directive 2014/68/EU, the EU declaration of conformity is part of these instructions.

1.4 Units

Units used in these instructions:

- Dimensions: Metric
- Torque units: Nm

2 Technical Data

2.1 Overview of ROTADISK Pneumatic Actuator versions

Make		ROTADISK						
								
Series/type		RD						
Functional principle/ control type		double-action/pneumatic						
Version		2.5	5	10	20	40	80	160
Weight in kg		0.85	1.4	3.46	5.78	13.2	25.6	46.9
Dimensions in mm	L	134	180	260	310	394	495	608
	W	65	78	90	108	138	168	204
	H*	82	91	117	133	177	213	278
Stroke in mm		25	32	42	53	66	84	104
Piston-Ø in mm		40	50	65	80	102	130	165
Filling volume per stroke in l		0.07	0.14	0.28	0.56	1.12	2.2	4.5

*Height without position indicator

Make		ROTADISK						
								
Series/type		RDF						
Functional principle/control type		single-action (spring-loaded return)/pneumatic with failsafe function						
Version		2.5	5	10	20	40	80	160
Available spring package		-1 -1.5 -2 -2.5 -3				-1 -1.3 -1.5 -1.8 -2 -2.5 -3		
Weight in kg		1,15	1,48	4,43	7,93	15,5	31,1	64,2
Dimensions in mm	L	187	260	340	440	485	630	835
	W	65	78	90	108	138	168	204
	H*	82	91	117	133	177	213	278
Stroke in mm		25	32	42	53	66	84	104
Piston-Ø in mm		40	50	65	80	102	130	165
Filling volume per stroke in l		0.07	0.14	0.28	0.56	1.12	2.2	4.5

*Height without position indicator

Make		ROTADISK Type RD & RDF	
Materials	Body	aluminium alloy (anodised)	
	Lid	aluminium alloy (PU multilayer paint)	
	Piston	aluminium alloy	
	Transmission shaft	stainless steel	
Control media/ operating media		compressed air (dry, filtered according to PNEUROP/ISO class 4 [50 µ]) neutral gases such as N ₂ , und CO ₂ hydraulic oil (water on request)	
Control pressure		standard: 3 to 8 bar (max. 8 bar) special versions: up to max. 10 bar (see nameplate)	
Operating temperature		standard: -20 °C to +80 °C temporary: -30 °C to +100 °C special version low temperature: -40 °C to +60 °C special version high temperature: -20 °C to +180 °C	
Direction of rotation		clockwise rotation anti-clockwise rotation (optional)	
Lubrication		permanent lubrication SAPPHIRE Lo-Temp 2 made by ROCOL	
Angle of rotation	90° ± 3° OPEN position, (not in RD 2.5)	90° ± 3° OPEN position, (not in RDF 2,5)	
	slewing actuator with stroke limitation (optional)	slewing actuator with stroke limitation (optional)	
Spring load cycles		—	10 ⁷ ± 10 000 000
Corrosion protection		anodised actuator body PU-painted lid	
Standardised interfaces for add-ons	fittings	DIN/ISO 5211 and DIN 3337	
	signal devices	VDI/VDE 3845	
	positioners		
	solenoid valves	– Namur 1/4"	

Available spring packages with number of springs for ROTADISK Type RDF single-action (spring-loaded return)

Spring package	Number of large springs	Number of small springs	Number of special springs ("medium")
-1	0	2	0
-1.5	1	1	0
-2	2	0	0
-2.5	2	1	0
-3	2	2	0
-1.3	0	1	1
-1.8	0	0	2

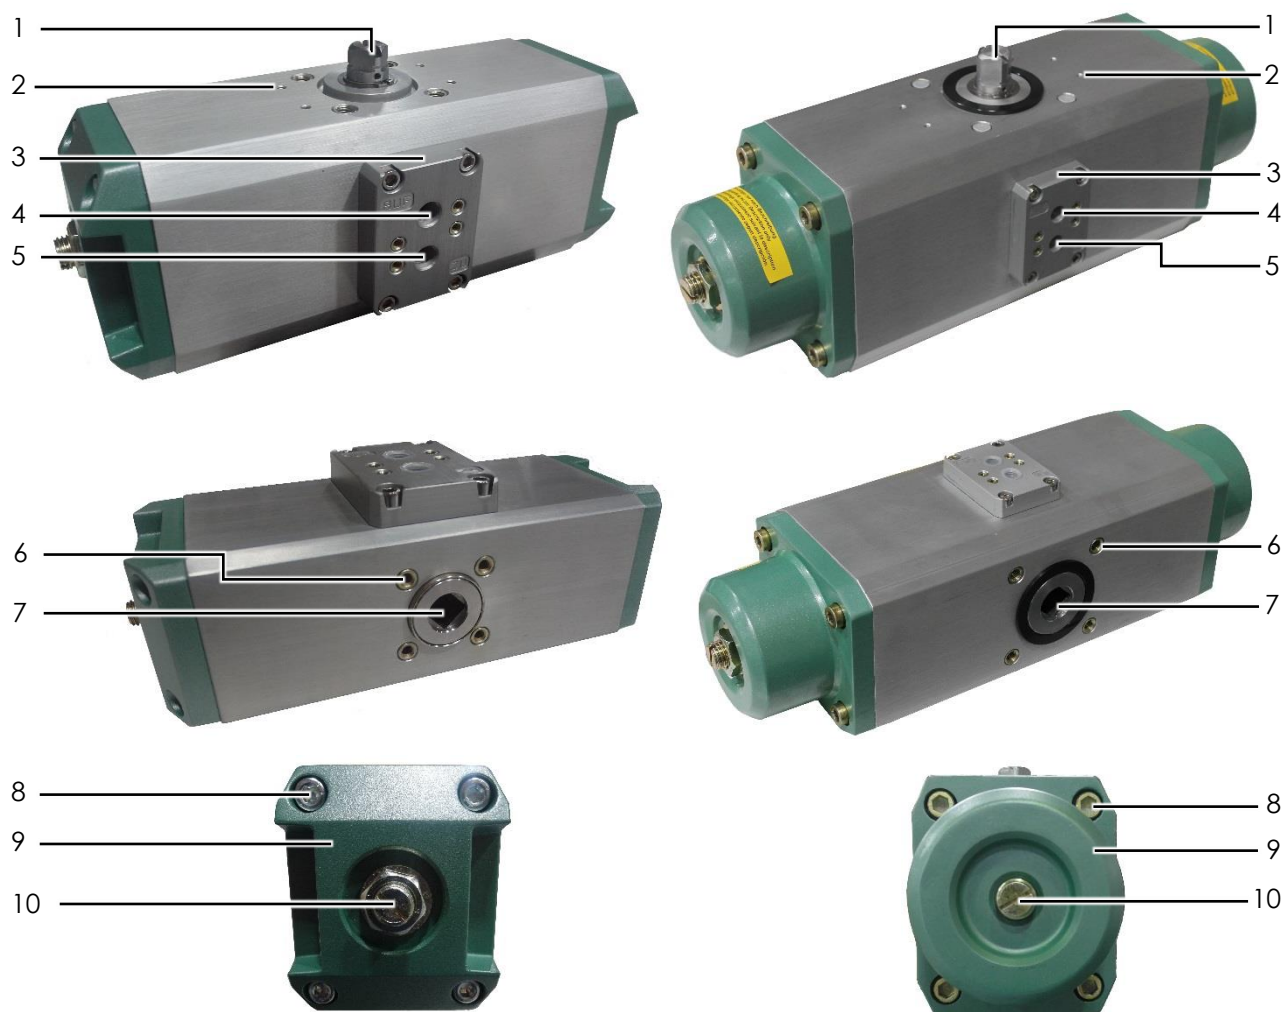



Figure 1: Components of the ROTADISK Pneumatic Actuators RD & RDF

Item	Component
1	transmission shaft (signal device side)
2	threaded fastening holes for signal devices (M5 x 7)
3	solenoid valve panel
4	control air connection OPEN
5	control air connection CLOSED
6	connection to fittings according to DIN ISO 5211
7	transmission shaft (fittings side)
8	hexagon socket head screws for fastening the lid
9	lid
10	threaded pin/end stop for end position setting (only in OPEN position is standard design, not in RD/F 2.5)

2.2 Nameplate: Identification of the ROTADISK Pneumatic Actuator

The nameplate that is affixed permanently to the ROTADISK Pneumatic Actuator contains the most important information regarding the design and application of the ROTADISK Pneumatic Actuators.

If the nameplate is missing or illegible, do not put the ROTADISK Pneumatic Actuator into operation and contact the *Quick Response Center (QRC)* of Flowserve Flow Control GmbH for support.

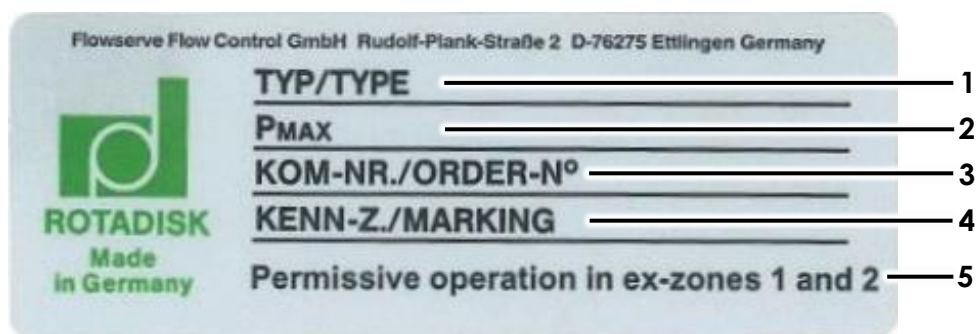

- 1 **Type designation**
(e.g. RDF 10-3 | RDF = version | 10 = size [from 2.5 to 160] |
-3 = spring package [only for RDF actuators])
- 2 **Maximum control pressure in bar**
- 3 **Commissioning number/order number**
- 4 **Identification number/serial number**
- 5 **Identification in which explosive areas (ex-zones) its use is permitted**

3 Safety Information

3.1 Intended Use

The RD & RDF is used within the operating parameters/operating limits exclusively for actuating fittings such as ball valves, valves, gate valves and check valves. Any other use of the actuators will be deemed not for the intended purpose. Use of the actuators for controlling the flow volume, especially, is in violation of the intended purpose. Use of the actuator on an unsuitable fitting is also considered not for the intended purpose.

To avoid personal injuries and material damages: Make sure that the operating parameters on the nameplate and the constructional design of the RD & RDF are suitable for the specific application.

➔ See section 2.2 Nameplate.

Observe all labels on the RD & RDF and keep them in a legible condition.

Replace damaged and/or illegible labels immediately.

The actuators may only be used within the permissible limits under consideration of the chemical and corrosive influences.

Safety notices on the actuator or on the fitting must be observed.

ROTADISK Pneumatic Actuators are basically suitable for use in explosive areas (ex-zones 1 and 2). ROTADISK Pneumatic Actuators have no own potential ignition sources when used as intended and are therefore not "devices" in the sense of article 1 of the directive 2014/34/EU ("ATEX Directive").

The following cases represent use not for the intended purpose (only reasonably foreseeable misuse):

- The RD & RDF is not used for actuating fittings (e.g. ball valves).
- The RD & RDF is not operated within the operating parameters/limit values specified on the nameplate.
- Installation, commissioning, maintenance, repair and other work on the RD & RDF are not carried out in compliance with this operation manual.
- The RD & RDF is put into operation without observing the instructions on the product.
- The RD & RDF is modified or used with spare parts that are not supplied by Flowserve Flow Control GmbH.
- The RD & RDF is put into operation without having passed all acceptance test criteria successfully.
- The RD & RDF is operated in a partially assembled state.

If you should be in any doubt as to the suitability of the RD & RDF for the respective intended application, please contact the *Quick Response Center (QRC)* of Flowserve Flow Control GmbH and state the serial number or article number of the ROTADISK Pneumatic Actuator specified on the nameplate.

Limits are also specified on the nameplate.

If the application conditions should change (for example, the temperature), please contact the *Quick Response Center (QRC)* of Flowserve Flow Control GmbH for support before putting the ROTADISK Pneumatic Actuator back into operation.

3.2 Safety Symbols and Description

This operation manual contains specific safety notices with signal word fields which can present a danger if not heeded. The specific signal word fields are:

Signal word field	Description
	DANGER This signal word field indicates a directly dangerous activity which can cause death or severe injury. Observe all safety notices with this signal word field to avoid the danger.
	WARNING This signal word field indicates a possibly dangerous activity which can cause death or severe injury. Observe all safety notices with this signal word field to avoid the danger.
	CAUTION This signal word field indicates a possibly dangerous activity which can lead to minor slight injuries. Observe all safety notices with this signal word field to avoid the danger.
	ATTENTION This signal word field indicates an activity which can lead to material damages. Observe all safety notices with this signal word field to avoid the danger.

Symbol/Warning sign	Description
	DANGER FROM MOVING PARTS
	DANGER FROM HOT SURFACE
	DANGER FROM COLD SURFACE
	DANGER FROM EXPLOSIVE ATMOSPHERE

3.3 Application Limits

The nameplate permanently attached to the body of the RD & RDF indicates the operating parameters/limit values of the device. The maximum permissible operating pressure and the maximum permissible operating temperature must not be exceeded.

3.4 General Sources of Danger

3.4.1 Mechanical Dangers

Lifting limits

The limits mentioned in this section are recommendations by Flowserve only. All lifting procedures must be carried out in accordance with the site safety regulations, the local regulations and the appropriate industrial standards.

Many precision parts have sharp edges which require the wearing of personal protective equipment when being handled. The employees must determine the approximate weight and stability of the load first before every lifting procedure.

- Large, unstable or unusual loads should always be handled with the assistance of additional personnel or suitable mechanical aids.
- Loads with a weight of more than 23 kg may only be lifted by suitable mechanical means and in compliance with the applicable local regulations or with the assistance of additional employees.
- The lifting of objects with a weight of less than 23 kg without help may be prohibited if the lifting is repetitive and/or unfavorable (i.e. away from the body, above shoulder height or below knee height) and therefore represents excessive strain for the employee.
- Repeated lifting of any kind should be assessed as part of a documented safety program for the end user.

3.5 Responsibility of the Operating Company

RD & RDF's are frequently used as safety-relevant components in industrial plants and piping systems. The operating company is responsible for the intended use or operation for the intended purpose of the ROTADISK Pneumatic Actuator and for all of the necessary work during the life cycle of the ROTADISK Pneumatic Actuator. They will take all the necessary preventive safety measures to protect the personnel and the environment.

The operating company is responsible for taking the following preventive safety measures:

- All applicable laws, technical safety regulations and standards, rules for the prevention of accidents and protection of the environment as well as company rules and regulations are observed and implemented.
- The ROTADISK Pneumatic Actuator is operated in a way that complies with these instructions and especially the safety notices, the handling instructions and section 3.1 Intended Use.
- The operating conditions and limits of the ROTADISK Pneumatic Actuator must be monitored continuously and all risks ensuing from operation of the ROTADISK Pneumatic Actuator must be ruled out.
- The ROTADISK Pneumatic Actuator is not operated by individuals who are not sufficiently qualified for exercising their activity. The personnel must be provided with extensive personal protective equipment (PPE) and suitable tools.
- Original spare parts and accessories of Flowserve Flow Control GmbH are used.
- No unauthorized modifications are made to the ROTADISK Pneumatic Actuator.

3.6 Qualified Personnel and Target Group

All individuals involved in the operation, installation and maintenance of the device must be qualified to perform the appropriate work. If the personnel do not already possess the necessary knowledge and skills, they must be trained and instructed accordingly. The operating company can contract the manufacturer/supplier to carry out appropriate training if necessary.

Always coordinate repair work with the operating and work safety personnel and observe all plant safety requirements as well as the valid health and safety protection laws and regulations.

3.6.1 Qualification of the Personnel

The personnel of the operating company who work with the ROTADISK Pneumatic Actuator must have the necessary knowledge and skills and satisfy the following conditions:

- Adequate qualification and personal suitability for the respective activity.
- Knowledge of the personal protective equipment (PPE) and how this equipment works.
- Knowledge of this operation manual and especially the safety notices and the sections relevant to the activities to be performed.

3.6.2 Target Groups

This operation manual is aimed at the following target groups:

- Management: The management of the operating company makes compliance and management decisions.
- Specialists: Specialists have completed a specific technical training and have experience and knowledge of relevant work requirements and suitable work equipment. Specialists are able to carry out the work assigned to them and to recognize and avoid potential work-related risks.
- Trained staff: Trained staff have been trained by the operating company in all the work they are to perform as well as with regard to the work-related risks.

3.7 Personal Protective Equipment

It is the responsibility of the owner/operator to provide the operating personnel with high-quality personal protective equipment (PPE). This personal protective equipment must also be suitable for work on the ROTADISK Pneumatic Actuator within the scope of the life cycle. The following personal protective equipment must be provided by the owner company:

Table 1: Personal protective equipment

Personal protective equipment	
	Protective helmet
	Protective glasses
	Protective gloves
	Safety shoes

3.8 General Sources of Hazard/Residual Hazards

This section describes general sources of hazard/residual hazards that exist during intended and improper use (reasonably foreseeable misuse).

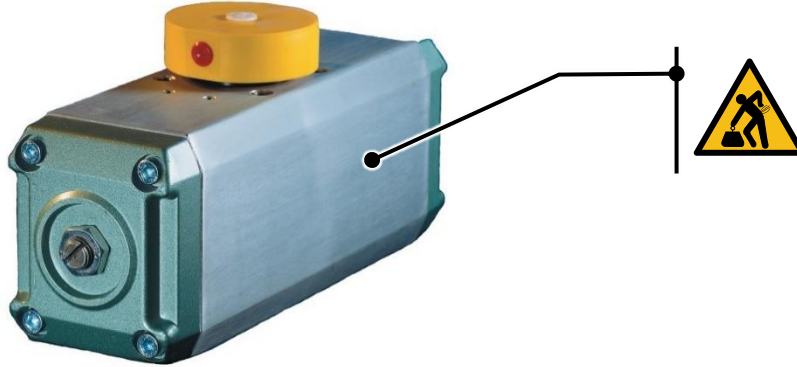


Figure 2: General sources of hazard/residual hazards of the ARGUS ball valves

⚠ WARNING

Danger of injury from a heavy ROTADISK Pneumatic Actuator!

A heavy ROTADISK Pneumatic Actuator (≥ 15 kg) can lead to back injuries when lifted without aids (e.g. lifting gear).

- ▶ Only lift the ROTADISK Pneumatic Actuator in accordance with the owner's safety protocol, the local regulations and industrial standards.
- ▶ Examine the approximate weight and stability of the ROTADISK Pneumatic Actuator before lifting the ROTADISK Pneumatic Actuator.
- ▶ Only lift the ROTADISK Pneumatic Actuator (≥ 15 kg) with suitable mechanical aids in accordance with current laws.
- ▶ Always wear personal protective equipment (PPE).

In addition, the following can occur in case of misuse (reasonably foreseeable misuse):

- Failure of basic pneumatic actuator functions
- Material damage to the industrial plant and pipeline system
- Failure of necessary maintenance and repair work
- General risks of injury for the operating personnel

4 Product Description

4.1 General Product Description

The ROTADISK Pneumatic Actuators serve for valve automation. They are available in two types:



- RD (double-action)
- RDF (single-action or spring-loaded return)

ROTADISK Pneumatic Actuators are based on a pneumatic twin piston drive according to the Scotch-Yoke principle which are designed primarily for switching check valves and ball valves. The twin piston drive is available in double-action and single-action versions. With the smallest possible outer dimensions, the Scotch-Yoke principle enables a high torque in the end positions.







The basic position in the standard design is CLOSED (*NC: normally closed* for single-action or spring-loaded return RDF pneumatic actuators) and the standard direction of rotation, looking onto the ROTADISK Pneumatic Actuator from above is clockwise (right-hand rotation) for closing and anti-clockwise (left-hand rotation) for opening.

There is also an optional alternative design with standard OPEN position (*NO: normally open* for single-action or spring-loaded return RDF pneumatic actuators). In this case, the direction of rotation is anti-clockwise (left-hand rotation) for closing and clockwise (right-hand rotation) for opening.

The tables below show the relation between design, type and piston position/transmission shaft position:

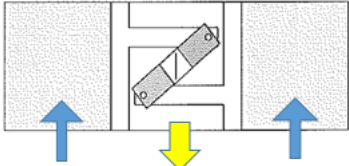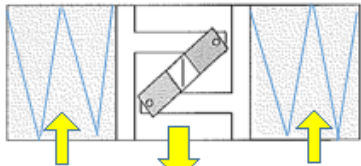Design	standard right-hand rotation (CW) or spring closing, <i>Normally Closed (NC) or Fail Close (FC)</i>	
Basic position	CLOSED	
Type	RD double-action	RDF single-action (spring closing)
Piston position/transmission shaft position after applied pressure/venting	transmission shaft position: CLOSED  interior vented exterior pressurised	transmission shaft position: CLOSED  interior vented

4 Product Description

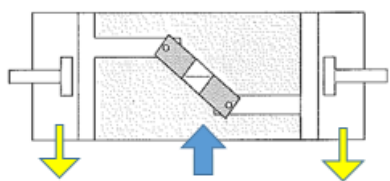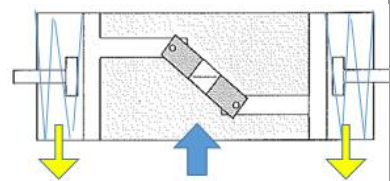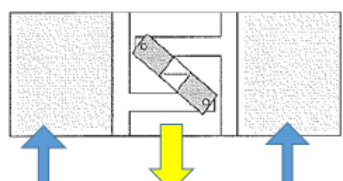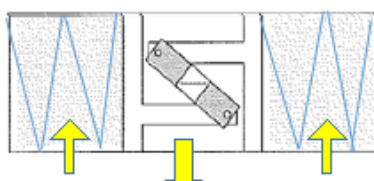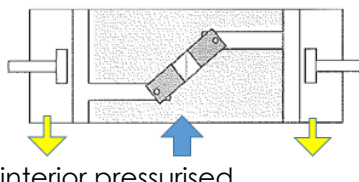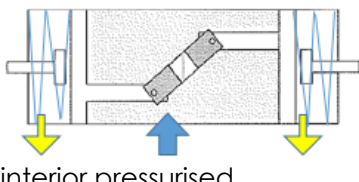	transmission shaft position: OPEN  interior pressurised exterior vented	transmission shaft position: OPEN  interior pressurised
Design	alternative left-hand rotation (CCW) or spring opening, <i>Normally Open (NO) or Fail Open (FO)</i>	
Basic position	OPEN	
Type	RD double-action	RDF single-action (spring opening)
Piston position/transmission shaft position after pressure applied/venting	transmission shaft position: OPEN  interior vented exterior pressurised	transmission shaft position: OPEN  interior vented exterior vented
	transmission shaft position: CLOSED  interior pressurised exterior vented	transmission shaft position: CLOSED  interior pressurised exterior vented

ROTADISK Pneumatic Actuators have a fail-safe function. This function ensures that the position is **LOAD** in the event of a compressed air drop in double-action ROTADISK Pneumatic Actuators of the RD type. This means that the ROTADISK Pneumatic Actuator stays in its last position in the event of a compressed air drop.

In single-action ROTADISK Pneumatic Actuators of the RDF type, the fail-safe function causes the ROTADISK Pneumatic Actuator to move into the **CLOSED** position by means of the springs (spring closing or *Fail Close*) in the event of a compressed air drop. Alternatively, it is also possible that the ROTADISK Pneumatic Actuator moves into the **OPEN** position by means of the springs (spring opening or *Fail Open*) in the event of a compressed air drop.

The slewing angle of the ROTADISK Pneumatic Actuators can be adjusted by $\pm 3^\circ$ with the standard end position setting¹.

The ROTADISK Pneumatic Actuators of the RD & RDF types have standardised interfaces for adding signal devices, positioners, solenoid valves and valves.

4.2 Variants

The ROTADISK Pneumatic Actuators of the RD & RDF types are available in different variants which differ with regard to the size, spring package and sealing material.

4.3 Functional Description

The ROTADISK Pneumatic Actuators of the RD & RDF types operate according to the double wing functional principle. The generated force is converted by two pistons (twin piston principle) and a lever, the double swing arm, into useful torque at the drive shaft. The design principle of the double swing arm achieves optimum transformation of the energy of the compressed air into the useful torque. The user therefore benefits from a low air consumption.


A high start and end torque results from the characteristic kinematic. The drive torque characteristic therefore corresponds almost ideally with the torque behaviour of a ball valve or a check valve. The compact design also allows later automation in confined spaces. The anodised drive body and the PU-painted li das well as the rust and acid-resistant drive shaft ensure reliable functioning even under the harsh conditions of the chemical industry.

The springs of the single-action pneumatic actuators are designed for more than 10⁷ load cycles and have optimal corrosion protection.

4.3.1 Double-action Function (ROTADISK Pneumatic Actuator Type RD)

The following functional description refers to a ROTADISK Pneumatic Actuator in standard design (↪ see section 4.1).

The interior of the ROTADISK Pneumatic Actuators is pressurised through connection "P1" between the two pistons. The pistons move apart. The force of both pistons is transmitted to by the double swing arm to the drive shaft which rotates anti-clockwise by 90°. This moves the pneumatic actuator into the "OPEN" position.

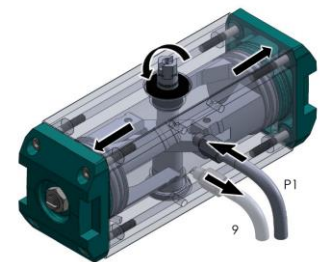

If connection "P2" is pressurised and "P1" vented, the two outer chambers are pressurised and the pistons move together. The drive shaft then rotates clockwise by 90° and the pneumatic actuator moves into the "CLOSED" position.




¹ The end position setting is only possible in the open position of right-hand rotating pneumatic actuators or the closed position of left-hand rotating pneumatic actuators. The end position setting is not possible in the RD/RDF 2.5 models.

4.3.2 Single-action Function (ROTADISK Pneumatic Actuator Type RDF)

The following functional description refers to a ROTADISK Pneumatic Actuator in standard design (↗ see section 4.1).

The interior is pressurised through connection "P1" between the two pistons. The pistons move apart and press the springs together. The force of both pistons is transmitted to by the double swing arm to the drive shaft which rotates anti-clockwise by 90°. This moves the pneumatic actuator into the "OPEN" position.

On venting the connection "P1", the spring force resets the pistons to the basic position whereby the drive shaft rotates clockwise by 90° and the pneumatic actuator moves into the "CLOSED" position.

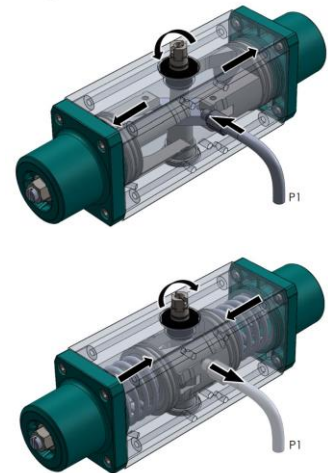

4.4 Scope of Delivery

The scope of delivery usually includes the following components:

- ROTADISK Pneumatic Actuator (usually switch to closed position)
- Operating manual (digital) including the EU declaration of conformity and declaration of incorporation
- Documents demanded by law or by the customer

Check whether the delivery complies with the specifications on the delivery note upon receipt of the goods.

Report any deviations immediately to the carrier and Flowserve Flow Control GmbH

5 Receipt of Goods

5.1 Safety Information



To avoid personal injury and/or material damage, make sure that the goods are examined and unpacked only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
☞ See chapter 3 Safety Information.

5.2 Examining Received Goods

1. Check the ROTADISK Pneumatic Actuator against the delivery note for completeness immediately upon receiving the goods.

A delivery note is enclosed with every delivery.

The information on the nameplate of the ROTADISK Pneumatic Actuator serves for clear identification and must match the information on the delivery note.

2. Check the ROTADISK Pneumatic Actuator for transport damage.
3. Report any defects and/or material damages immediately to the carrier and Flowserve Flow Control GmbH.

Flowserve Flow Control GmbH must receive all claims in writing within one month of receipt of the ROTADISK Pneumatic Actuator.

Please note that Flowserve Flow Control GmbH will be unable to accept later claims.

5.3 Unpacking the ROTADISK Pneumatic Actuator

1. Open the box or wooden crate.
2. Loosen and remove the entire packing and load securing material (for example, wedges).
3. Lift the ROTADISK Pneumatic Actuator out of the box and/or wooden crate (☞ see chapter 12.2 Packing the ROTADISK Pneumatic Actuator).
4. In case of a heavy ROTADISK Pneumatic Actuator (≥ 15 kg), the ROTADISK Pneumatic Actuator must be lifted out of the box or wooden crate with lifting gear and straps (☞ see chapter 12.2 Packing the ROTADISK Pneumatic Actuator).
4. Break up the box and/or wooden crate.
5. Dispose of boxes and/or wooden crates, pallets, support frames, skeleton boxes and all packing and load securing materials that are no longer needed (see also section 14.2 for disposal).
5. Transport the ROTADISK Pneumatic Actuator carefully to the application site (☞ see the chapter 12.2 Packing the ROTADISK Pneumatic Actuator).

6 Installation

6.1 Safety Information



To avoid personal injury and/or material damage, make sure that installation work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
⚡ See chapter 3 Safety Information.

⚠ DANGER

Danger of injury due to incorrect installation of the ROTADISK Pneumatic Actuator on the valve!

Incorrect installation can lead to the valve not switching correctly. This can cause severe injuries or even death.

- ▶ Make sure, on installation, that the valve and the pneumatic actuator have identical basic settings.

NOTICE

Danger of material damage due to incorrect installation of the ROTADISK Pneumatic Actuator on the valve!

Incorrect installation can lead to the valve not switching correctly. This can cause material damage.

- ▶ Make sure, on installation, that the valve and the pneumatic actuator have identical basic settings.

6.2 Preparations for ROTADISK Pneumatic Actuator Installation

Make the following preparations before installing the ROTADISK Pneumatic Actuator on the valve or pipeline:

- Make sure that the load capacity of the pipeline is sufficient to support the ROTADISK Pneumatic Actuator with valve and add-on components.
- Make sure that there is enough free space around the ROTADISK Pneumatic Actuator with valve and add-on components to allow installation work without risks.
- Provide suitable installation equipment (e. g. lifting gear, installation device, torque wrench, open-ended wrench, valve wrench, assembly grease).
- Determine suitable installation alternatives (direct installation or installation by means of console).

Direct installation is possible when the dimensions of the drive shaft and the ISO flange of the ROTADISK Pneumatic Actuator match those of the valve (e. g. ball valve) and the ISO flange of the valve has a through-hole. Differences in dimensions to transmission shaft of the valve could be compensated by optionally available reducers.

Installation by means of a console is necessary when the differences in dimensions between the drive shaft of the ROTADISK Pneumatic Actuator and the transmission shaft of the actuator cannot be compensated by reducers or the ISO flanges do not match. This installation alternative can also be used for high/low medium temperatures or thick pipe insulations.

6.3 Installing ROTADISK Pneumatic Actuator on the Valve

The ROTADISK Pneumatic Actuator has a standardised DIN/ISO 5211 valve interface on which valves can be mounted with the aid of installation kits in accordance with EN 15081. For valve installation, see also the enclosed valve product information (e. g. instructions).

Important for the correct switching of the valve by the ROTADISK Pneumatic Actuator is that the valve and the pneumatic actors have an identical basic setting. Contact the *Quick Response Center (QRC)* of Flowserve Flow Control GmbH for installation support.



Figure 3: ARGUS ball valve with installed ROTADISK Pneumatic Actuator RDF (closed ball position)

7 Commissioning

7.1 Safety Information



To avoid personal injury and/or material damage, make sure that commissioning, flushing and pressure testing work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.

⚡ See chapter 3 Safety Information.

⚠ DANGER

Danger of injury due to failure to observe plant-specific regulations!

Failure to observe plant-specific regulations can cause severe injuries or even death.

- ▶ Observe plant-specific regulations.
- ▶ Observe safety information in section 3

NOTICE

Danger of material damage due to control medium!

A wrong control medium or too high control pressure (> 8 bar) can cause material damage to the ROTADISK Pneumatic Actuator.

- ▶ Use only a gaseous control medium (usually compressed air or neutral gases such as N₂, CO₂).
- ▶ Apply at most the maximum control pressure to the ROTADISK Pneumatic Actuator that is specified on the nameplate.

7.2 Commissioning the ROTADISK Pneumatic Actuator

Observe the specifications in the manufacturer documentation (e.g. ball valve instructions) of the automatic valve components for commissioning work.

1. Check the pipework and all control lines for leakages.
2. Connect the power supply to the pneumatic actuator control components.
3. Connect the compressed air supply.
4. Check the function of optionally mounted auxiliary devices.
5. Switch the valve (e.g. ball valve) with the ROTADISK Pneumatic Actuator and check whether
 - the valve opens and closes correctly.
 - the red dot on the yellow position indicator of the ROTADISK Pneumatic Actuator points in longitudinal or flow direction when the valve is open (opening of the ball parallel to flow direction).
 - the red dot on the yellow position indicator of the ROTADISK Pneumatic Actuator points transversely to the flow direction when the valve is closed (opening of the ball is turned 90° to the flow direction) (see Figure 3, page 24).

8 Maintenance

8.1 Safety Information



To avoid personal injury and/or material damage, make sure that maintenance work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
 ↗ See chapter 3 Safety Information.

8.2 Required Spare Parts for Maintenance

Under particularly harsh operating conditions, the sealing elements of the ROTADISK Pneumatic Actuator can begin to show signs of wear after a certain time. Moreover, very critical or extreme operating conditions may necessitate periodic replacement of the ROTADISK Pneumatic Actuator components.

Suitable spare parts are required for maintenance work. Flowserve Flow Control GmbH offers repair sets or spare parts kits for every ROTADISK Pneumatic Actuator. In order for Flowserve Flow Control GmbH to be able to offer suitable repair sets and spare parts kits for the ROTADISK Pneumatic Actuator, the ROTADISK Pneumatic Actuator must be clearly identified.

This technical identification is provided either by a reference to the customer order documents (e.g. delivery note or invoice) or by the data on the nameplate.

8.3 Maintenance Plan

The recommended inspections/maintenance work can be carried out in the installed state. As a rule, it applies that the normal industrial plant operation must not be interrupted. In case of a leakage, damage and/or faulty operating state: ↗ See chapter 9 Repair.

Table 2: Recommended maintenance work for the pipeline section

No.	Inspections/maintenance work	Interval
1	Check pneumatic actuator body and body lid for cracks.	every 3 months
2	Checked screwed hose unions for leaks (pressure loss) using a leak spray.	
3	Check seals of the threaded pins/end stops for leaks with a leak spray.	
4	Check whether a lock nut on the stop screws has come loose.	

9 Repair

9.1 Safety Information



To avoid personal injury and/or material damage, make sure that repair work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
⚡ See chapter 3 Safety Information.

⚠ DANGER

Danger of injury due to improper repair work on the ROTADISK Pneumatic Actuator!

Improper repair work on the ROTADISK Pneumatic Actuator can lead to severe injury or even death.

- ▶ Do not carry out repair work on a ROTADISK Pneumatic Actuator when it is in operation and/or under pressure.
- ▶ Do not carry out repair work on ROTADISK Pneumatic Actuators without consultation and support by Flowserve Flow Control GmbH.
- ▶ Do not unscrew the lid of the ROTADISK Pneumatic Actuator RDF without the disassembly device (the lids are under high spring tension!).
- ▶ Contact service teams of Flowserve Flow Control GmbH or the Flowserve Quick Response Centers if repair work needs to be carried out.

⚠ DANGER

Danger of injury due to high spring tension!

A lid under spring tension can cause severe injury or even death if you remove it without an assembly device with press.

- ▶ Do not loosen/unscrew lid screws without an assembly device with press.
- ▶ Contact Flowserve Flow Control GmbH if no assembly device with press is available.

9.2 Required Spare Parts

Under particularly harsh operating conditions, the sealing elements of the ROTADISK Pneumatic Actuator can begin to show signs of wear after a certain time. Moreover, very critical or extreme operating conditions with approx. 500,000 to 1,000,000 cycles may necessitate periodic replacement of the ROTADISK Pneumatic Actuator components. Suitable spare parts are required for this repair work. Flowserve Flow Control GmbH offers spare parts kits for every ROTADISK Pneumatic Actuator.

In order for Flowserve Flow Control GmbH to be able to offer suitable spare parts kits for the ROTADISK Pneumatic Actuator, the ROTADISK Pneumatic Actuator must be clearly identified.

This technical identification can be provided by the data on the nameplate.

9.3 Required Spare Parts

Under particularly harsh operating conditions, the sealing elements of the ROTADISK Pneumatic Actuator can begin to show signs of wear after a certain time. Moreover, very critical or extreme operating conditions with approx. 500,000 to 1,000,000 cycles may necessitate periodic replacement of the ROTADISK Pneumatic Actuator components. Suitable spare parts are required for this repair work. Flowserve Flow Control GmbH offers spare parts kits for every ROTADISK Pneumatic Actuator.

In order for Flowserve Flow Control GmbH to be able to offer suitable spare parts kits for the ROTADISK Pneumatic Actuator, the ROTADISK Pneumatic Actuator must be clearly identified.

This technical identification can be provided by the data on the nameplate.

9.4 Repairing the ROTADISK Pneumatic Actuator



Do not carry out your own repair work on ROTADISK Pneumatic Actuators without consultation and support by Flowserve Flow Control GmbH because the very size of the pneumatic actuator also presents a considerable danger.

The following repair instructions (installation and disassembly instructions) describe the replacement of (worn) seals which are usually the reason for leakages.

Please note that these repair instructions describe the principal procedure for replacing the seals of ROTADISK Pneumatic Actuators (RD/RDF 2,5–160) and that this repair work entails considerable risks.

Do not carry out your own repair work on the ROTADISK Pneumatic Actuator without suitable tools (e.g. an assembly device with press), original spare parts and prior consultation with Flowserve Flow Control GmbH.

In case of damage, contact the *Quick Response Center (QRC)* of Flowserve Flow Control GmbH.

9.4.1 Replacing Seals on the ROTADISK Pneumatic Actuator (RDF 2,5–160)

Prerequisite: The ROTADISK Pneumatic Actuator is

- taken out of operation (no compressed air supply is connected).
- Disconnected from the valve and all other sub-assemblies (e.g. solenoid valve, limit switch, position indicator or position controller).

⚠ DANGER

Danger of injury due to high spring tension!

A lid under spring tension can cause severe injury or even death if you remove it without an assembly device with press.

- ▶ Do not loosen/unscrew lid screws without an assembly device with press.
- ▶ Contact Flowserve Flow Control GmbH if no assembly device with press is available.

1. Make different marks on the edges of both lids [2] on the top of the body.

*The marks simplify correct installation of the ROTADISK Pneumatic Actuator after disassembly.
Make sure that you do not adjust the nuts of the threaded pins/end stops so that the pre-set end position setting and thus the angle of rotation of $90^\circ \pm 3^\circ$ is retained.*



2. Mark the position of the drive shaft groove on the body [10].

Figure 1: Standard design, Fail Close (FC)



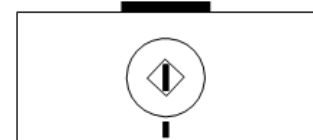


Figure 2: Alternative design (inverse direction of rotation), Fail Open (FO)

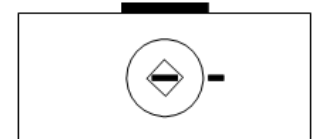


3. Clamp the ROTADISK Pneumatic Actuator in an assembly device with press.

The assembly device with press prevents the lid [2] from being flung off by spring tension when the lid screws [1] are unscrewed.

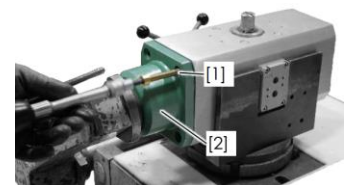


4. Loosen the lid screws [1] diagonally opposed on the lid [2].


5. Take the spring package out of the side of the body.
6. Repeat the previous steps for the other side of the body.
7. Unscrew the locking pin (threaded pin) [5] from the drive shaft.
8. Remove the black support ring [17].

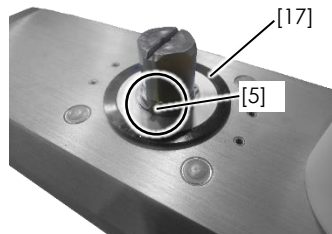


9. Remove the shaft locking ring [6] and the washer [7].

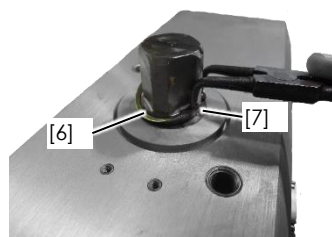

10. Pull the shim bushing [8] out of the body [10].

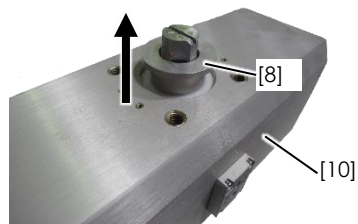


11. Knock the drive shaft [4] out of the body [10] with a rubber hammer.
12. Remove the bearing bushes [15] and the Q/O-rings [12][14] from the body [10].
13. Press out the piston pair [9] with a soft tool until it is flush with the body [10].

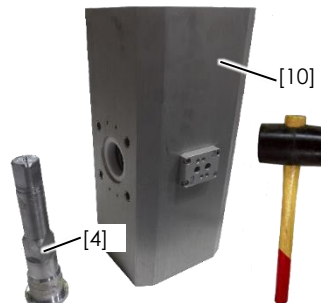

- 14.** Mark the piston [9] and the body end wall.

Ideally, a felt-tipped pen or scribe is used for marking.



- 15.** Then push the piston pair [9] completely out of the body [10].


- 16.** Clean the drive shaft [4], shim bushing [8], double swing arm [11], body [10] and piston pair [9].

Do not use a solvent to clean the piston pair [10].



- 17.** Grease the cleaned parts with low-temperature grease.

Flowserve Flow Control GmbH recommends the low-temperature grease SAPPHIRE Lo-Temp 2 made by ROCOL.

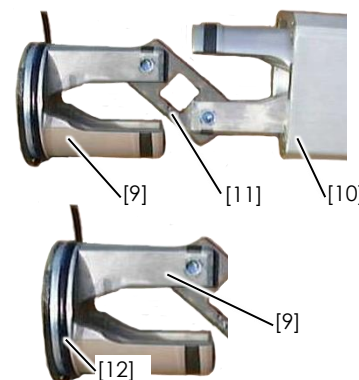

- 18.** Pull the new O-rings [12] onto both pistons [9].

- 19.** Assemble the two pistons [9] with the double swing arm [11] in a piston pair [9].


- 20.** Hold the guide bands tight and push the piston pair [9] back into the body [10].

Make sure that the marks on the piston [9] and body wall are in line.

- 21.** Centre the piston [9] or double swing arm [11] in the middle below the shaft bearing.

- 22.** Grease the bearing opening [13] on the bottom side of the body flange.



Flowserve Flow Control GmbH recommends the low-temperature grease SAPPHIRE Lo-Temp 2 made by ROCOL.

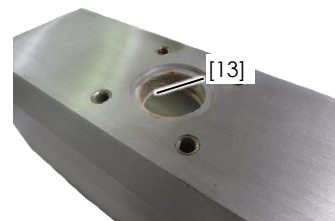


- 23.** Fit a new Q-ring [14] to the bottom side of the body flange and a new bearing bush [15] into the bearing opening [13].

- 24.** Grease the bearing opening [13] on the top body flange side.

Flowserve Flow Control GmbH recommends the low-temperature grease SAPPHIRE Lo-Temp 2 made by ROCOL.

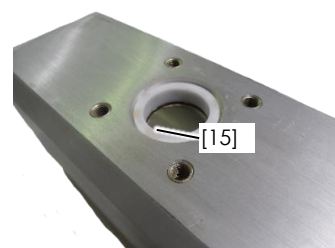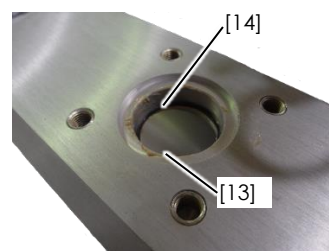


- 25.** Fit a new greased Q-ring [14] on the top body flange side and a new bearing bush [15] into the bearing opening [13].

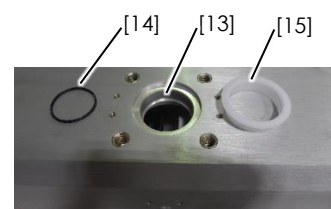


- 26.** Press the greased drive shaft [4] carefully into the body [10] from the bottom.


Make sure that the groove in the drive shaft [4] has the original position (transverse or parallel to the longitudinal axis).

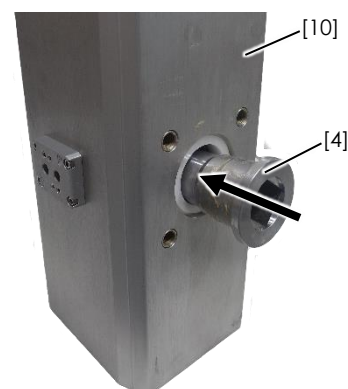


- 27.** Place a new O-ring [12] in the shim bushing [8].



- 28.** Insert the shim bushing [8] into the bearing opening.

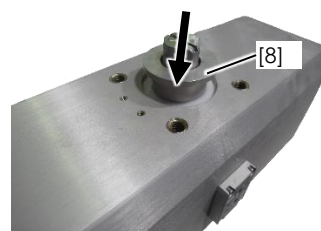


- 29.** Place the washer [7] over the drive shaft [4].

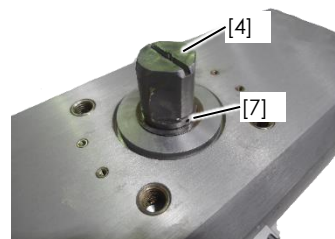

- 30.** Fit the shaft locking ring [6].


Make sure that the sharp side is facing upwards.

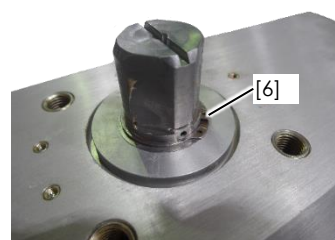


- 31.** Mount both lids [2] with spring package on the body [10].

Use an assembly device with press and the lid screws [1] for mounting.

Also check whether the marks (↗ see step 1) on the lid [2] and body [10] match.

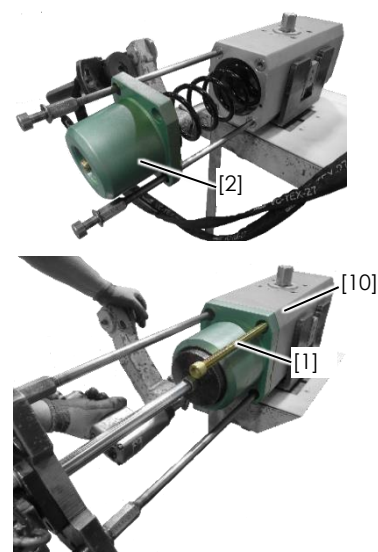

- 32.** Screw the locking pin (threaded pin) [5] into the drive shaft [4].

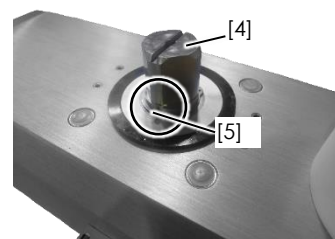

- 33.** Place the black support ring [17] onto the shim bushing [8].



- 34.** Fit the position indicator [16].
- 35.** Check the ROTADISK Pneumatic Actuator for correct direction of rotation and leaks.



9.4.2 Replacing Seals on the ROTADISK Pneumatic Actuator (RD 2,5–160)

Prerequisite: The ROTADISK Pneumatic Actuator is

- taken out of operation (no compressed air supply is connected).
- Disconnected from the valve and all other sub-assemblies (e.g. solenoid valve, limit switch, position indicator or position controller)., Stellungsanzeiger oder Stellungsregler) getrennt.

1. Make different marks on the edges of both lids [2] on the top of the body.


The marks simplify correct installation of the ROTADISK Pneumatic Actuator after disassembly.

Make sure that you do not adjust the nuts of the threaded pins/end stops so that the pre-set end position setting and thus the angle of rotation of $90^\circ \pm 3^\circ$ is retained.




2. Remove the lids [2] from the ROTADISK Pneumatic Actuator by loosening the lid screws [1] on both sides of the body.

Use a suitable assembly device for this.

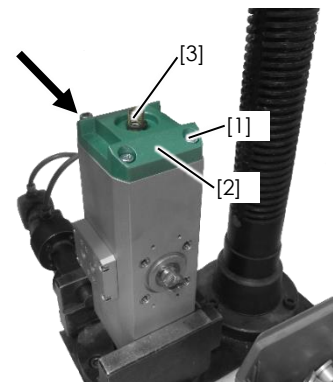

3. Move the pistons up to the inside stop by turning the drive shaft [4] on the outer square bar.

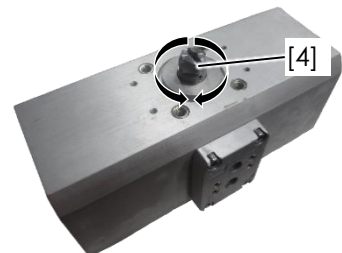

4. Mark the position of the drive shaft groove on the body [10].

Figure 1: Standard design



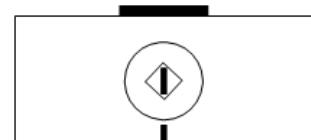


Figure 2: Alternative design (inverse direction of rotation)

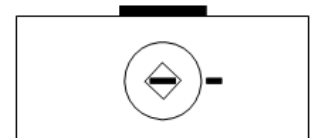


5. Unscrew the locking pin (threaded pin) [5] from the drive shaft.


6. Remove the black support ring [17].

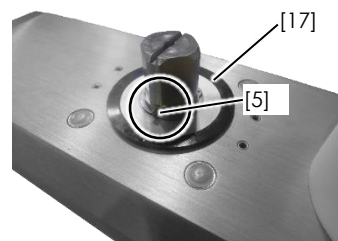


7. Remove the shaft locking ring [6] and the washer [7].

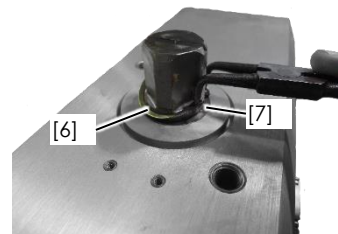

8. Pull the shim bushing [8] out of the body [10].

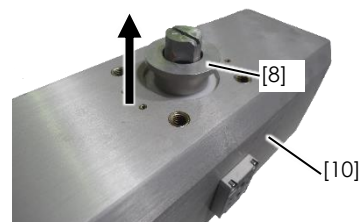

9. Knock the drive shaft [4] out of the body [10] with a rubber hammer.

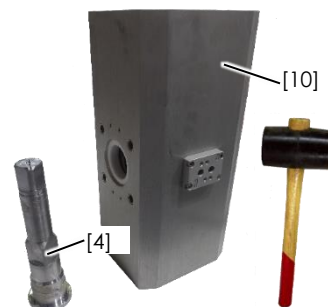


10. Remove the bearing bushes [15] and the Q/O-rings [12][14] from the body [10].

11. Push out the piston pair [9] with a soft tool until it is flush with the body [10].

12. Mark the piston [9] and the body end wall.

Ideally use a felt-tipped pen or scribe for marking.



13. Then push the piston pair [9] completely out of the body [10].

14. Clean the drive shaft [4], shim bushing [8], double swing arm [11], body [10] and piston pair [9].

Do not use a solvent to clean the piston pair [10].

15. Grease the cleaned parts with low-temperature grease.

Flowserve Flow Control GmbH recommends the low-temperature grease SAPPHIRE Lo-Temp 2 made by ROCOL.

16. Pull new O-rings [12] onto the two pistons [9].

17. Assemble the two pistons [9] with the double swing arm [11] in a piston pair [9].


18. Hold the guide bands tight and feed the piston pair [9] back into the body [10].

Make sure that the marks on the piston [9] and the body wall are in line.



19. Centre the pistons [9] or double swing arm [11] in the middle under the shaft bearing.

20. Grease the bearing opening on the bottom body flange side [13].


Flowserve Flow Control GmbH recommends the low-temperature grease SAPPHIRE Lo-Temp 2 made by ROCOL.

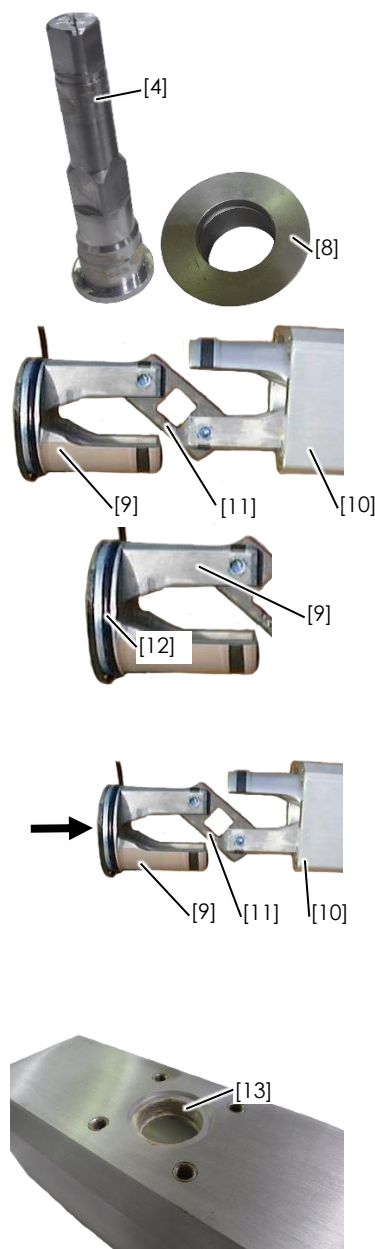

- 21.** Fit a new Q-ring [14] on the bottom body flange side and a new bearing bush [15] into the bearing opening [13].

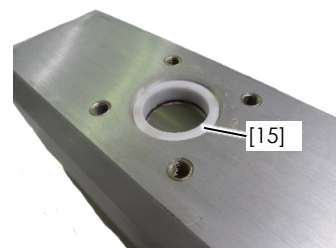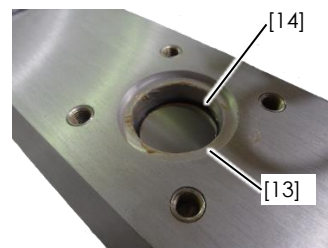


- 22.** Fit a new greased Q-ring [14] on the top body flange side and a new bearing bush [15] into the bearing opening [13].

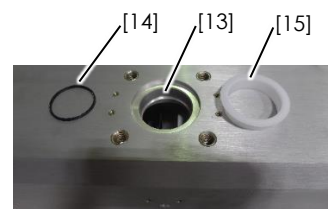


- 23.** Press the greased drive shaft [4] carefully into the body [10] from the bottom.


Make sure that the groove in the drive shaft [4] has the original position (transverse or parallel to the longitudinal axis).

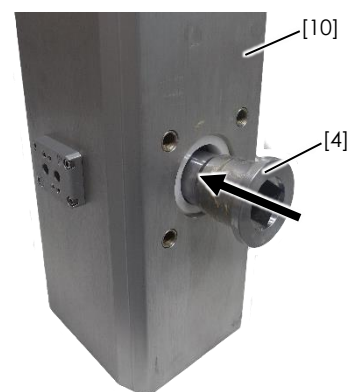


- 24.** Place a new O-ring [12] in the shim bushing [8].



- 25.** Insert the shim bushing [8] into the bearing opening.

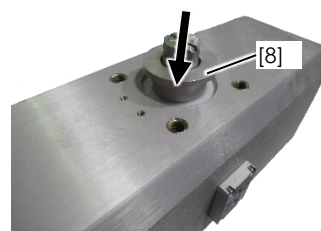


- 26.** Place the washer [7] over the drive shaft [4].

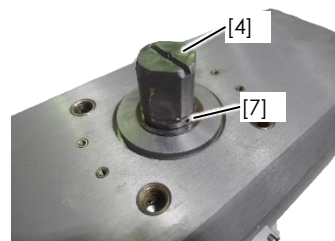

- 27.** Fit the shaft locking ring [6].


Make sure that the sharp side is facing upwards.

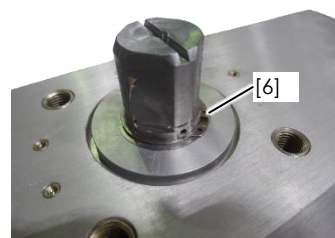


- 28.** Mount both lids [2] on the body [10].

Use an assembly device with press and the lid screws [1] for mounting.

Also check whether the marks (↗ see step 1) on the lid [2] and body [10] match.

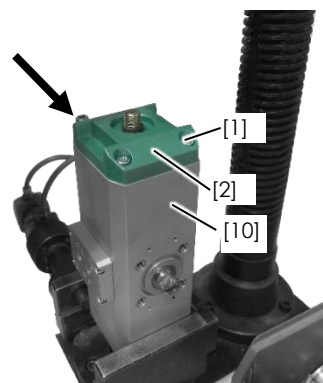


- 29.** Screw the locking pin (threaded pin) [5] into the drive shaft [4].

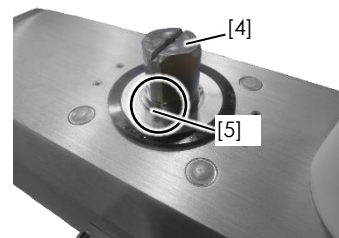

- 30.** Place the black support ring [17] on the shim bushing [8].



- 31.** Fit the position indicator [16].
- 32.** Check the ROTADISK Pneumatic Actuator for correct direction of rotation and leaks.

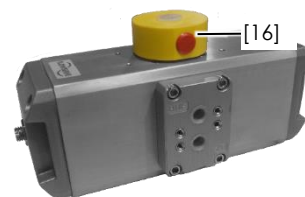

9.5 Troubleshooting Table

Because of the large number of ROTADISK Pneumatic Actuator versions and applications, it is not possible to describe all kinds of problems, causes and remedies in the troubleshooting table below.

It is generally an advantage to contact the service teams of Flowserve Flow Control GmbH or the *Flowserve Quick Response Centers* to get specific support.

Table 3: Troubleshooting table

No.	Problem description	Possible cause	Remedies/ Recommended actions
1	Fault on the ROTADISK Pneumatic Actuator	The control unit has no power supply.	Connect power supply.
		There is no compressed air supply.	Connect compressed air supply. Make sure that no vent is blocked (e.g. by a completely closed throttle valve).
		The control air lines to the drive are defective, leaking, blocked or connections have been switched.	Check control air lines for leaks, unhindered flow, correct laying.
		Control components are not connected correctly.	Check control components (e.g. solenoid valves, position controllers) for correct connection. Check whether the control components switch with a control signal.
2	Fault on the valve	Add-on between pneumatic actuator and valve is defective or installed incorrectly.	Repair or correctly install the add-on.
		The pneumatic actuator is too "weak".	Design control pressure or sparing package correctly.
		Transmission shaft/ball connection defective.	Repair valve.

9.6 Sending In the ROTADISK Pneumatic Actuator for Repair

If you are unable to repair the ROTADISK Pneumatic Actuator with the help of this chapter, send the ROTADISK Pneumatic Actuator to Flowserve Flow Control GmbH for repair.

Please make sure that the ROTADISK Pneumatic Actuator is free from hazardous fluid residues and other substances as well as cleaned and preserved before it is sent in to Flowserve Flow Control GmbH. Flowserve Flow Control GmbH will only open and repair the ROTADISK Pneumatic Actuator if a decontamination certificate and the safety data sheet of the ROTADISK Pneumatic Actuator are enclosed. Flowserve Flow Control GmbH provides you with a form for the decontamination certificate and the safety data sheet prior to dispatch.

Prerequisite: The ROTADISK Pneumatic Actuator to be sent in is

- free from fluid residues and other substances.
 - cleaned.
 - preserved.
1. Pack the ROTADISK Pneumatic Actuator properly for dispatch. (↪ See chapter 11.2 Storing the ROTADISK Pneumatic Actuator).
 2. Fill in and sign the decontamination certificate and safety data sheet to Flowserve Flow Control GmbH in advance or attach the documents well visibly to the outside of the shipped goods.

*The decontamination certificate and the safety data sheet certify that the ROTADISK Pneumatic Actuator presents no risk for persons and the environment.
Flowserve Flow Control GmbH will only accept the returned goods if a completely filled in and signed decontamination certificate and safety data sheet are enclosed with them.*

3. Send the goods to Flowserve Flow Control GmbH.

10 Shutdown

10.1 Safety Information



To avoid personal injury and/or material damage, make sure that shutdown work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
⚡ See chapter 3 Safety Information.

10.2 Shutting Down the ROTADISK Pneumatic Actuator

10.2.1 Prerequisites for Shutdown

Make sure that the following prerequisites are fulfilled before shutting down and disassembling:

- The owner's specifications for shutdown and disassembly are observed.
- The pipework and the ROTADISK Pneumatic Actuator are depressurised and free from fluid residues and cooled down so that there is no danger of injury.

10.2.2 Shutting Down the ROTADISK Pneumatic Actuator

For shutting down, observe the information in the manufacturer's documentation (e.g. Ball Valve instructions) of the automatic valve components.

1. Take the pipework out of operation.
2. Switch the valve (e.g. ball valve) several times so that fluid residues and entrapped pressure can escape.
3. Make sure that there are no fluid residues or other substances in the pipework.
4. Disconnect the power and air supply from the ROTADISK Pneumatic Actuator and its control components.
5. Dismantle the ROTADISK Pneumatic Actuator from the valve.

11 Storage

11.1 Safety Information



To avoid personal injury and/or material damage, make sure that storage work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
🔧 See chapter 3 Safety Information.

⚠ DANGER

Danger of injury due to falling loads!

Falling of suspended loads can lead to severe injury or death.

- ▶ Never stand beneath suspended loads.

NOTICE

Danger of material damage due to unsuitable storage!

Unsuitable storage of the ROTADISK Pneumatic Actuator can lead to material damage.

- ▶ Observe the measures in the following sections.

11.2 Storing the ROTADISK Pneumatic Actuator

The following prerequisites are satisfied:

The ROTADISK Pneumatic Actuator

- is not connected to and has been dismantled from the valve (e.g. ball valve).
 - is free from dirt.
 - is dry.
1. In the case of a heavy ROTADISK Pneumatic Actuator (≥ 15 kg), strap the sling loops of a suitable lifting gear around the body of the ROTADISK Pneumatic Actuator or fasten the slings to the lifting eyes (if available).
 2. Transport the ROTADISK Pneumatic Actuator to its storage location (🔧 see chapter 12.2 Packing the ROTADISK Pneumatic Actuator).
 3. Place the ROTADISK Pneumatic Actuator carefully into a pallet box.
 4. Ensure the following storage conditions to prolong the service life of the ROTADISK Pneumatic Actuator:

Storage conditions for the ROTADISK Pneumatic Actuator:

Indoor areas/rooms (long-term storage):

- dry, free from dust and adequately aired
- storage temperature between $+1$ °C and $+50$ °C
- relative humidity of < 50 %

Outdoors/construction sites (short-term storage; ≤ 14 days):

- storage temperature between -10 °C and $+50$ °C

12 Packing

12.1 Safety Information



To avoid personal injury and/or material damage, make sure that packing work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
⚡ See chapter 3 Safety Information.

NOTICE

Danger of material damage due to unsuitable packing!

Unsuitable packing of the ROTADISK Pneumatic Actuator can lead to material damage during transport.

► Observe the measures in the following sections.

12.2 Packing the ROTADISK Pneumatic Actuator

The following prerequisites are satisfied:
The ROTADISK Pneumatic Actuator

- is not connected to and has been dismantled from the valve (e.g. ball valve).
- is free from dirt.
- is dry.

1. Select suitable packing to ensure that the ROTADISK Pneumatic Actuator reaches its destination without damage.

Select suitable packing and observe intended destination, customer specifications, applicable laws, load securing regulations, the properties of the transport goods (size, weight, dimensions), protection requirements and means of transport (road, rail, air and sea freight).

2. Protect the ROTADISK Pneumatic Actuator against tipping and slipping if necessary.
3. Attach suitable and clearly legible transport symbols to the packing – especially for sea freight – in accordance with ISO 780 and DIN 55402 if necessary.

Transport markings on the wooden crates are either stuck on or sprayed on with weather-proof paint.

Possible transport symbols are:

 This way up

 Protect from wet

 Centre of gravity

 Attach here

 Delicate packed goods

 Protect from heat (direct sunlight)

 Do not use hooks

13 Transport

13.1 Safety Information



To avoid personal injury and/or material damage, make sure that transport work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
🔗 See chapter 3 Safety Information.

⚠ DANGER

Danger of injury due to falling loads!

Falling of suspended loads can lead to severe injury or death.

- ▶ Never stand beneath suspended loads.

⚠ WARNING

Danger of injury due to improper transport!

Improper transport can lead to severe injuries.

- ▶ Secure the ROTADISK Pneumatic Actuator against turning and tipping.
- ▶ Attach slings to the ROTADISK Pneumatic Actuator correctly.
🔗 See the following section 13.2.

Never lift the whole unit (ball valve and actuator) with one lifting gear with the slings attached only to the pneumatic actuator!

- ▶ Observe all load securing regulations.

NOTICE

Danger of material damage due to improper transport!

Improper transport of the ROTADISK Pneumatic Actuators can cause damage.

- ▶ Observe the measures in the following sections.

13.2 Transporting the ROTADISK Pneumatic Actuator

The following prerequisites are satisfied:

The ROTADISK Pneumatic Actuator

- is not connected to and has been dismantled from the valve (e.g. ball valve).
 - is free from dirt.
 - is dry.
1. Protect the ROTADISK Pneumatic Actuator against damage with suitable transport protection (e.g. packing blanket).
 2. In the case of a heavy ROTADISK Pneumatic Actuator (≥ 15 kg), strap the sling loops of a suitable lifting gear around the body of the ROTADISK Pneumatic Actuator or fasten the slings to the lifting eyes (if available).
 3. Make sure that the ROTADISK Pneumatic Actuator cannot turn when lifted.
 4. Hang the sling loops in the load hook of a suitable lifting gear.
 5. Transport the ROTADISK Pneumatic Actuator to the desired location and set it down carefully.
 6. Remove the slings from the ROTADISK Pneumatic Actuator.

14 Disposal and Recycling

14.1 Safety Information



To avoid personal injury and/or material damage, make sure that disposal and recycling work is performed only by qualified personnel with suitable personal protective equipment (PPE) and suitable tools.
⚡ See chapter 3 Safety Information.

14.2 Disposing of and Recycling the ROTADISK Pneumatic Actuator

At the end of the service life of the ROTADISK Pneumatic Actuator, all relevant materials and parts must be recycled or disposed of in compliance with local environment laws and regulations. If the ROTADISK Pneumatic Actuator contains hazardous substances or toxic fluid residues which are harmful to health and the environment, the ROTADISK Pneumatic Actuators must be disassembled and disposed of in accordance with local/regional disposal regulations and laws.

The safety data sheet of hazardous substances or toxic fluid residues contains important information on disposal and recycling.

Prerequisite: The ROTADISK Pneumatic Actuator

- is shut down.
- is disconnected/dismantled from the valve (e.g. ball valve).
- is not under pressure.
- Is decontaminated (free from hazardous substances or toxic fluid residues).

The two lids of the ROTADISK Pneumatic Actuator RDF are removed(⚡ see section 9.4.1).

1. Hand over the ROTADISK Pneumatic Actuator to an authorised disposal or recycling company.

An authorised disposal or recycling company will process the disposal or recycling of the ROTADISK Pneumatic Actuator.

Appendix A: Manufacturer's Declaration



MANUFACTURER'S DECLARATION ACC. DIRECTIVE 2014/34/EU

TRANSLATION OF ORIGINAL AZ1799_DE

Product

ROTADISK Pneumatic Actuator Types:
RD 2.5, RD 5, RD 10, RD 20, RD 40, RD 80, RD 160
and RDF 2.5, RDF 5, RDF 10, RDF 20, RDF 40, RDF 80, RDF 160

Manufacturer

Flowserve Flow Control GmbH
Rudolf-Plank-Str. 2
76275 Ettlingen
Deutschland / Germany

Directive

Directive 2014/34/EU of the European Parliament and of the Council of 26 February 2014 ... "relating to equipment and protective systems ... for use in potentially explosive atmosphere" – "ATEX Directive"

Flowserve Flow Control GmbH, the manufacturer, hereby declares that the mentioned products were subjected to a risk assessment procedure considering the valid harmonized standards and good engineering practice.

The pneumatic actuators do not have their own potential source of ignition and are thus not considered "equipment" as defined by article 2, paragraph 1 of Directive 2014/34/EU.

The Directive does not apply to the mentioned actuators.

The user instructions must be followed.

Applied Standards:

- EN 15198:2007
- EN 1127-1:2019
- EN ISO 80079-36:2016
- EN ISO 80079-37:2016



Peter Benien
Managing Director



Dirk Malischewsky
Head of Research & Development

Ettlingen, 02.10.2020

Flowserve Flow Control GmbH
argus@flowserve.com
www.flowserve.com

Experience In Motion

AZ1799 EN S.1/1
Rev.: F

Appendix B: Declaration of Incorporation



DECLARATION OF INCORPORATION ACCORDING TO DIRECTIVE 2006/42/EC

TRANSLATION OF ORIGINAL AZ2287_DE

Product

ROTADISK brand pneumatic actuator, types:
RD 2.5, RD 5, RD 10, RD 20, RD 40, RD 80, RD 160 and
RDF 2.5, RDF 5, RDF 10, RDF 20, RDF 40, RDF 80, RDF 160

Manufacturer

Flowserve Flow Control GmbH
Rudolf-Plank-Str. 2
76275 Ettlingen
Deutschland / Germany

Directive

Directive 2006/42/EC of the European Parliament and of the Council of 17 May 2006, „European Machinery Directive“

Person Authorised to Compile the Relevant Technical Documentation

Flowserve Flow Control GmbH
Rudolf-Plank-Str. 2
76275 Ettlingen
Deutschland / Germany

Flowserve Flow Control GmbH as manufacturer hereby declares that the products listed meet the basic requirements of directive 2006/42/EC as "partly completed machinery":

Annex I, sections 1.1.2, 1.1.3, 1.1.5, 1.2.1, 1.2.6, 1.3.1, 1.3.2, 1.3.4, 1.3.7, 1.3.8, 1.5.2, 1.5.4, 1.5.7, 1.6.1, 1.7.1 and 1.7.4.

Commissioning is prohibited until it has been ensured that the complete machine or system in which the ROTADISK actuators are installed complies with the provisions of directive 2006/42/EC.

The relevant technical documentation for the partly completed machinery according to Annex VII Part B of the directive has been prepared and the manufacturer is obliged to transmit this documentation electronically to national authorities upon justified request.

The instructions must be observed.

Considered standard:

- EN ISO 12100:2010



Peter Benien
Managing Director



Dirk Malschewsky
Head of Design Engineering and R&D

Ettlingen, den 16.12.2020

Flowserve Flow Control GmbH
argus@flowserve.com
www.flowserve.com

Experience In Motion

AZ2287 EN S.1/1
Rev.: -

Appendix C: Torques of the ROTADISK Pneumatic Actuators

Series/Type RD	Control pressure (bar)								
	2	3	3.5	4	4.5	5	6	7	8
2.5	10	15	17,5	20	22,5	25	30	35	40
5	20	30	35	40	45	50	60	70	80
10	40	60	70	80	90	100	120	140	160
20	80	120	140	160	180	200	240	280	320
40	160	240	280	320	360	400	480	560	640
80	320	480	560	640	720	800	960	1120	1280
160	640	960	1120	1280	1440	1600	1920	2240	2560

Series/ Type RDF		Control pressure (bar)								Spring
		3	3,5	4	4,5	5	6	7	8	
2.5-1	at 0°	10.5	14	16.5	–	–	–	–	–	3.5
	at 90°	9	11.5	14	–	–	–	–	–	6
2.5-2	at 0°	8	10.5	13	16	18.5	23.5	–	–	6.5
	at 90°	4	7.2	10.5	12.5	15	20	–	–	10
2.5-3	at 0°	–	–	8	10.5	13	18	24	29	11
	at 90°	–	–	3	5.5	8.5	14	17.5	22.5	17.5
5-1	at 0°	23	28	33	38	–	–	–	–	7
	at 90°	17	22	27	32	–	–	–	–	13
5-1.5	at 0°	20	25	30	35	40	–	–	–	10
	at 90°	15	20	25	30	35	–	–	–	15
5-2	at 0°	17	22	27	32	37	47	–	–	13
	at 90°	13	18	23	28	33	43	–	–	17
5-2.5	at 0°	–	18	23	28	33	43	53	–	16
	at 90°	–	11	16	21	26	36	46	–	23
5-3	at 0°	–	15	20	25	30	40	50	–	20
	at 90°	–	5	10	15	20	30	40	–	30
10-1	at 0°	50	60	70	80	–	–	–	–	10
	at 90°	40	50	60	70	–	–	–	–	20
10-1.5	at 0°	43	53	63	73	83	–	–	–	17
	at 90°	30	40	50	60	70	–	–	–	30

Appendix C: Torques of the ROTADISK Pneumatic Actuators

Series/ Type RDF		Control pressure (bar)								Spring
		3	3,5	4	4,5	5	6	7	8	
10-2	at 0°	35	45	55	65	75	95	–	–	25
	at 90°	20	30	40	50	60	80	–	–	40
10-2.5	at 0°	–	40	50	60	70	90	110	–	30
	at 90°	–	20	30	40	50	70	90	–	50
10-3	at 0°	–	35	45	55	65	85	105	125	35
	at 90°	–	10	20	30	40	60	80	100	60
20-1	at 0°	95	115	135	15	–	–	–	–	25
	at 90°	80	100	120	140	–	–	–	–	40
20-1.5	at 0°	85	105	125	145	165	–	–	–	35
	at 90°	60	80	100	100	140	–	–	–	60
20-2	at 0°	70	90	110	130	150	190	–	–	50
	at 90°	40	60	80	100	120	160	–	–	80
20-2.5	at 0°	–	80	100	120	140	180	–	–	60
	at 90°	–	40	60	80	100	140	–	–	100
20-3	at 0°	–	65	85	105	125	165	205	245	75
	at 90°	–	20	40	60	80	120	160	200	120
40-1	at 0°	180	220	260	300	–	–	–	–	60
	at 90°	145	185	225	265	–	–	–	–	95
40-1.5	at 0°	140	180	220	260	300	–	–	–	100
	at 90°	90	130	170	210	250	–	–	–	150
40-2	at 0°	100	140	180	220	260	340	–	–	140
	at 90°	35	75	115	155	195	275	–	–	205
40-2.5	at 0°	–	–	150	190	230	310	–	–	170
	at 90°	–	–	65	105	145	225	–	–	255
40-3	at 0°	–	–	120	160	200	280	360	440	200
	at 90°	–	–	20	60	100	180	260	340	300
80-1	at 0°	360	440	520	600	–	–	–	–	120
	at 90°	290	370	450	530	–	–	–	–	190
80-1.5	at 0°	280	360	440	520	–	–	–	–	200
	at 90°	185	265	345	425	–	–	–	–	295
80-2	at 0°	200	280	360	440	520	–	–	–	280
	at 90°	85	165	245	325	405	–	–	–	395
80-2.5	at 0°	–	–	300	380	460	620	–	–	340
	at 90°	–	–	150	230	310	470	–	–	490

Appendix C: Torques of the ROTADISK Pneumatic Actuators

Series/ Type RDF		Control pressure (bar)								Spring
		3	3,5	4	4,5	5	6	7	8	
80-3	at 0°	–	–	240	320	400	560	720	880	400
	at 90°	–	–	55	135	215	375	535	695	585
160-1	at 0°	720	880	1040	1200	–	–	–	–	240
	at 90°	595	755	915	1075	–	–	–	–	365
160-1.5	at 0°	560	720	880	1040	–	–	–	–	400
	at 90°	390	550	710	870	–	–	–	–	570
160-2	at 0°	400	560	720	880	1040	1360	–	–	560
	at 90°	185	345	505	665	825	1145	–	–	775
160-2.5	at 0°	–	–	600	760	920	1240	–	–	680
	at 90°	–	–	321	481	641	961	–	–	959
160-3	at 0°	–	–	480	640	800	1120	1440	1760	800
	at 90°	–	–	140	300	460	780	1100	1420	1140

*Torques specified in Newton meter [Nm]



Flowserve Factory Contacts:

Flowserve Flow Control GmbH
Rudolf-Plank-Str. 2
76275 Ettlingen
Germany
Phone: +49 7243 1030
Fax: +49 7243 103222
Email: argus@flowserve.com
www.flowserve.com

Instructions for download:



www.flowserve.com/en/argus-iom

Local Flowserve Representative:

To find your local Flowserve representative use the Sales Support Locator System found at www.flowserve.com.

FLOWSERVE REGIONAL SALES OFFICES:

America

Flowserve Corporation
3993 W. Sam Houston
Parkway North
Suite 100
Houston, TX 77043

China

Beijing Flow Control Operations
22A1/A2, Hanwei Plaza
No. 7 Guanghua Road,
Chaoyang District,
Beijing 100004, China

Flowserve China & Southeast Asia
Suzhou Office
No.49 Weixin Road,
Suzhou Industrial Park,
Jiangsu Province, China, 215122

Asia Pacific

Flowserve Pte. Ltd.
12 Tuas Avenue 20
Republic of Singapore 638824
Phone: 65 862 3332
Fax: 65 862 2800

Flowserve Corporation has established industry leadership in the design and manufacture of its products. When properly selected, this Flowserve product is designed to perform its intended function safely during its useful life. However, the purchaser or user of Flowserve products should be aware that Flowserve products might be used in numerous applications under a wide variety of industrial service conditions. Although Flowserve can provide general guidelines, it cannot provide specific data and warnings for all possible applications. The purchaser/user must therefore assume the ultimate responsibility for the proper sizing and selection, installation, operation, and maintenance of Flowserve products. The purchaser/user should read and understand the instructions included with the product and train its employees and contractors in the safe use of Flowserve products in connection with the specific application.

While the information and specifications contained in this literature are believed to be accurate, they are supplied for informative purposes only and should not be considered certified or as a guarantee of satisfactory results by reliance thereon. Nothing contained herein is to be construed as a warranty or guarantee, express or implied, regarding any matter with respect to this product. Because Flowserve is continually improving and upgrading its product design, the specifications, dimensions and information contained herein are subject to change without notice. Should any question arise concerning these provisions, the purchaser/user should contact Flowserve Corporation at any one of its worldwide operations or offices. For more information about Flowserve Corporation, contact www.flowserve.com or call USA 1-800-225-6989.

© November 2020, Flowserve Corporation, Irving, Texas